

**NOTICE**  
**PORTIONS OF THIS REPORT ARE ILLEGIBLE.**

CONF-830930--1

It has been reproduced from the best available copy to permit the broadest possible availability.

DE84 004022

APPROACHES TO MEASUREMENT OF THERMAL-HYDRAULIC PARAMETERS IN LIQUID-METAL-COOLED FAST BREEDER REACTORS

**DISCLAIMER**

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

John I. Sackett  
EBR-II Engineering  
Argonne National Laboratory  
Idaho Falls, Idaho, U.S.A.

**ABSTRACT**

This lecture considers instrumentation for liquid-metal-cooled fast breeder reactors (LMFBR's). Included is instrumentation to measure sodium flow, pressure, temperature, acoustic noise, and sodium purity. It is divided into three major parts: 1) measurement requirements for sodium cooled reactor systems, 2) in-core and out-of-core measurements in liquid metal systems, and 3) performance measurements of water steam generators.

**1. INTRODUCTION**

One of the most important uses of liquid metals in power production is as a coolant for breeder reactors. Liquid sodium is used for a number of important reasons. First, it transfers heat efficiently, allowing high power densities in the reactor core and increasing the rate at which fuel can be produced in the breeder blanket. At EBR-II for example, the power density is about 1 MW per liter of core volume.

Another reason is the high boiling point (895°C) of sodium, allowing the system to operate at low pressure and high temperature (typically 485°C reactor outlet temperature). The capability to transfer heat at high temperature and low pressure in sodium results in relatively high thermal efficiencies for LMFBR's and, perhaps just as important, large safety margins to accommodate off-normal events which result in increased fuel or coolant temperatures.

Finally, sodium has a relatively high heat capacity, allowing for reasonable flow rates through the heat transfer circuit and moderate pressure drops. Its disadvantages rest primarily with its chemical properties which require that it be reliably separated from both air and water. It should be noted, however, that components which operate in sodium systems have been found to suffer very little degradation from effects associated with the chemical properties of sodium.

However, LMFBR's present unique instrumentation requirements because of the high-temperature sodium coolant. Certain properties of sodium, for example good thermal and electrical conductivity, allow for novel application of instrumentation, notably magnetic flowmeters. Other properties, for example chemical reactivity with water and opaqueness, require unique instrumentation to ensure plant operability and safety. An excellent paper reviewing these considerations is that of Hughes (reference 1), reviewing the status of LMFBR instrumentation as

**MASTER**

CONF-830930--1

of 1981. In addition to reviewing the present status of LMFBR instrumentation, the emphasis given in this paper is on recent operating experience, providing the reader with an overview of approaches to LMFBR instrumentation and the most promising results. Much of the information is keyed to the experience at the Experimental Breeder Reactor II (EBR-II) in the USA, the longest operating LMFBR in the world.

Sodium flow can be monitored by a number of methods including standard  $\Delta P$  techniques (flow orifices, venturies), and electromagnetic, ultrasonic, and tracer techniques.<sup>1,2,3</sup> These techniques have been used in LMFBR plants with varying levels of success. The major objective is to provide reliable flow instrumentation that can survive the high temperatures of sodium, requiring minimal maintenance over a 40-year plant life. Some plants provide flowmetering of individual fuel subassemblies where, in addition to concerns for high temperature, radiation damage is also a major consideration.

Pressure in sodium systems can be measured by relatively conventional means using NaK-filled capillary tubes from pressure transducers. Experience has shown pressure sensors to operate quite reliably in sodium systems, more reliably than flowmeters and in some cases better than temperature sensors.

A major emphasis in temperature monitoring for LMFBR plants has been the development of reliable fast-response thermocouples<sup>4</sup> (time constants of 0.5 s or less). In particular, much attention has been given to the ability to detect rapid temperature fluctuations associated with a developing flow blockage or the onset of sodium boiling. Likewise, the development of acoustic monitors to detect sodium boiling in individual fuel subassemblies has been pursued as a backup to temperature or flow monitoring in individual subassemblies.<sup>5</sup>

Because sodium is opaque and reacts with oxygen, operations within the primary system must be conducted remotely without the benefit of direct vision. For this reason, attention has been given to development of under-sodium viewing devices which depend on ultrasonic signal transmission for their operation. These viewing devices have been successfully tested in a number of sodium systems, most notably by the British at the PFR.<sup>5,6</sup>

The acoustic monitors associated with development of boiling detection under-sodium viewing systems are also potentially valuable for detecting loose mechanical parts or for monitoring such mechanical operations in the primary system as fuel handling. This has proven to be of great benefit at EBR-II, for example.

Sodium purity is of special concern in sodium systems because of the chemical reactivity of sodium with oxygen. Too much contamination of the sodium with oxygen can lead to problems of corrosion in the primary system or, if severe enough, the blockage of small flow passages when the temperature of the sodium is decreased. Consequently, instruments to measure the level of oxygen contamination (as well as other impurities) have been developed and extensively tested.<sup>7</sup>

The performance of steam generators in LMFBR's is also of concern because of the highly energetic reaction that takes place between sodium and water. It is important to provide a highly reliable leaktight boundary between sodium and water in the steam-generating system. Likewise, it is important to provide instrumentation to detect leaks so that if they do occur, appropriate actions can be taken (such as rapidly draining the sodium lines). The most common

method of leak detection is to monitor the sodium for the presence of hydrogen that results from the reaction of sodium and water.<sup>8</sup> Another approach is to provide acoustic sensors to monitor for the leakage of steam to the sodium system.<sup>9</sup>

## 2. MEASUREMENT REQUIREMENTS FOR SODIUM COOLED REACTOR SYSTEMS

### 2.1 General Instrument Requirements

LMFBR power plants include both a primary heat-transport system (PHTS) and an intermediate heat-transport system (IHTS) filled with sodium. The IHTS serves to isolate the radioactive primary system from the steam system so that a leak at the steam system would not release radioactivity.

A typical arrangement is shown in Fig. 1 (the French plant, Super-Phenix). Also shown is a similar diagram for EBR-II (Fig. 2). The arrangements of the PHTS are of two basic types, loop and pool. This difference is important because the challenges presented for plant instrumentation are different. Shown in Fig. 3 is a plant of the loop type, the Fast Flux Test Facility (FFTF). In the loop system, the primary piping and major components (pumps, intermediate heat exchangers, and flowmeters) are more easily accessible for maintenance and repair. In the pool system, the primary piping and major PHTS components are submerged in a tank of sodium, which makes instrumentation somewhat more difficult. High reliability is needed in such a system because the components are difficult to remove for inspection.

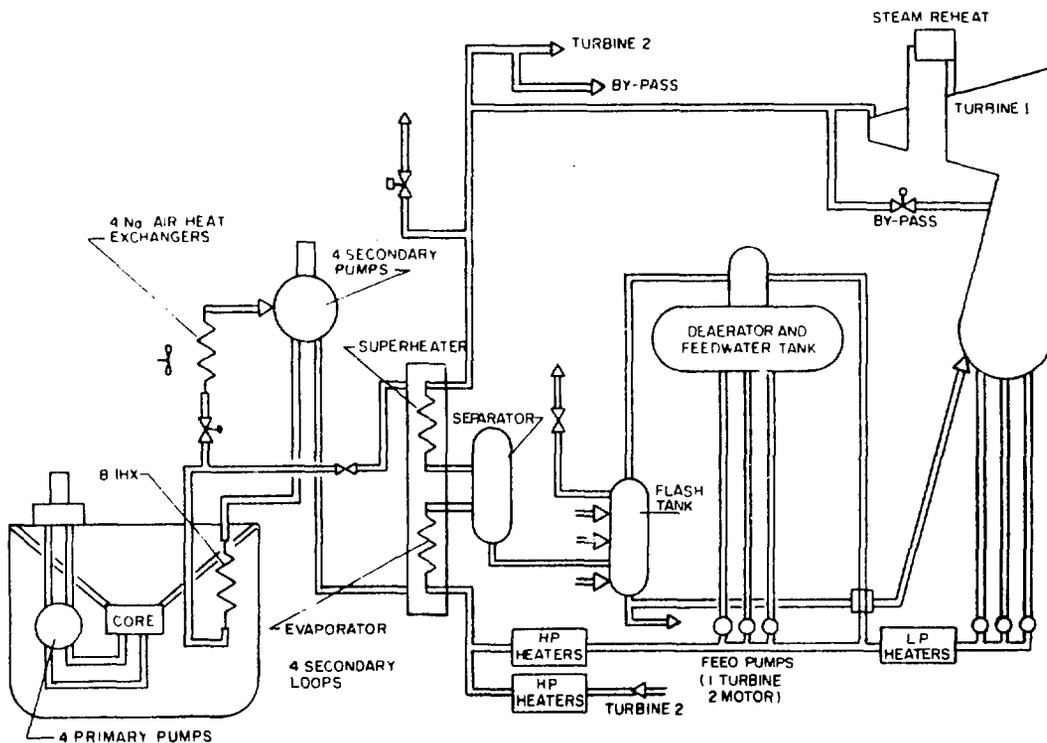


Fig. 1 SIMPLIFIED HEAT TRANSPORT PATH FOR SUPER PHENIX

Instrumentation for the heat-transport systems provide for control, protection, and diagnosis of normal and off-normal conditions. Important components of the system are the piping, pumps, intermediate heat exchanger (IHX), and steam generator. Typically, sodium flow rate is measured in the PHTS and the IHTS by the use of magnetic or ultrasonic flowmeters. Steam and water flows are measured by the use of conventional  $\Delta P$  flowmeters (venturi or sharp-edge orifice).

LMFBR's are especially well instrumented for temperature measurements, relying primarily on chromel-alumel thermocouples at critical locations throughout the plant. Besides the typical requirements for measuring temperatures in the heat transport loops, special concerns associated with sodium circuits include the potential existence of stratified regions of sodium at markedly different temperature in large tanks or pipes, and in the existence of large temperature gradients in structures. These concerns led, for example, to the placement of a large number of TC's within the primary tank of EBR-II, because little was known about the way sodium would perform in these systems. The most important measurements required to monitor and control power level and heat rejection are at the inlet and outlet of the core (including the outlet of individual subassemblies), inlet and outlet of the IHX, inlet and outlet of the pumps, and inlet and outlet of the steam generators (evaporators and superheaters). Chromel/alumel thermocouples are commonly used, as well as resistance temperature detectors (RTD's) in a few applications.

Pressure measurements in sodium systems are useful as plant protection inputs. These measurements are typically made at the outlet of the pumps and outlet of the reactor core. (In pool systems, the pressure across the IHX is measured as a difference in height between the hot and cold sodium pools.) Pressure is usually measured in sodium with a NaK-filled line from the sensor.

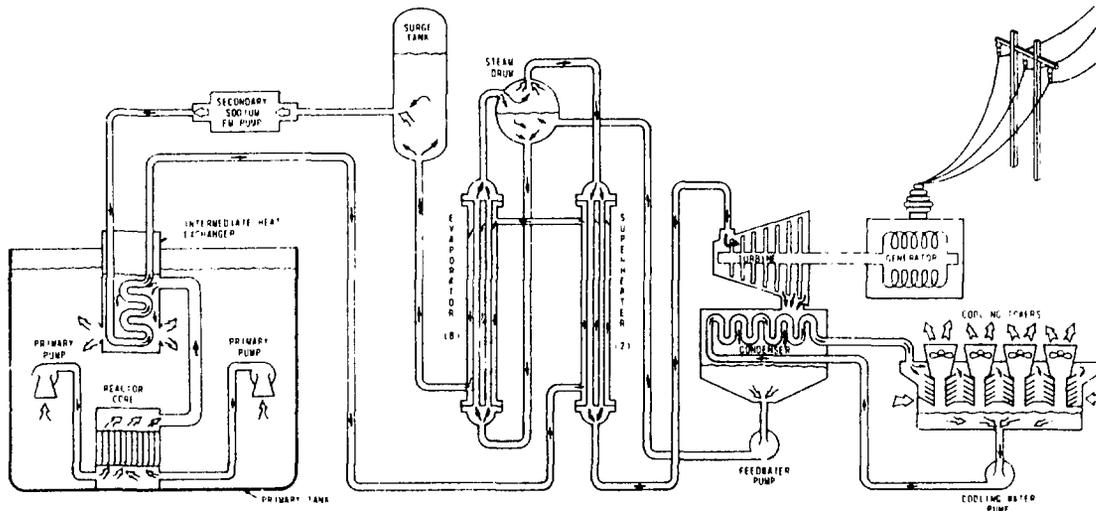


Fig. 2 HEAT TRANSPORT SYSTEM FOR EBR-II

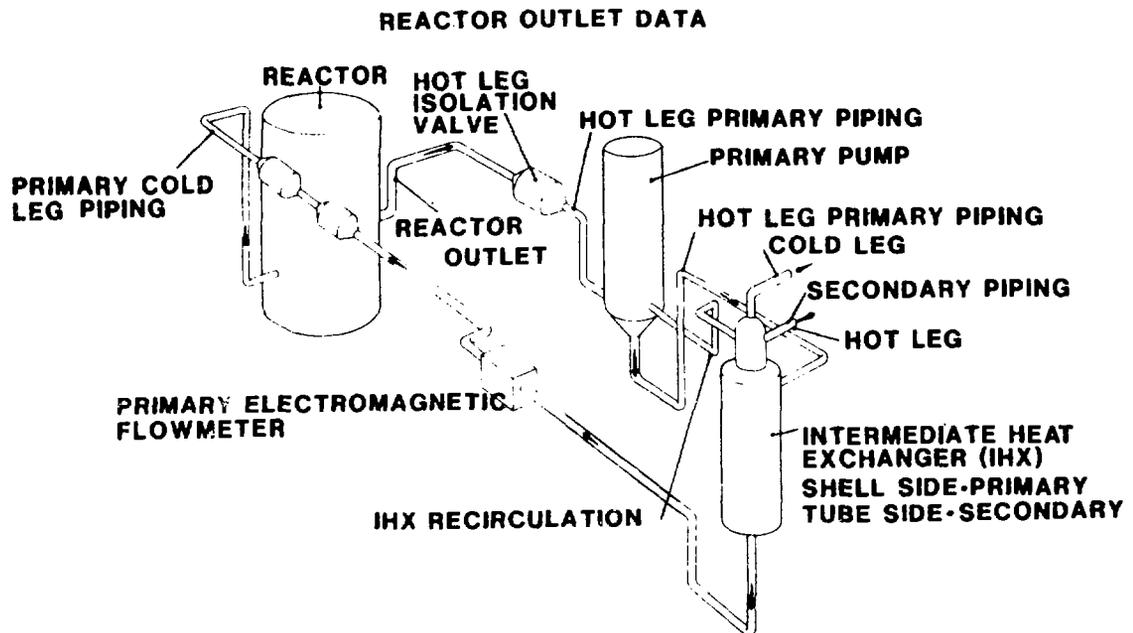


Fig. 3 FFTF HEAT TRANSPORT LOOP

Other important measurements include sodium level (typically measured by inductive probes), pump speeds and power, leakage of sodium or water, contamination of sodium, and changes in the level or character of acoustic signals.


A major difference in instrumentation between loop and pool systems is in flow monitoring. Because the pool system provides a parallel flow circuit between pumps and intermediate heat exchangers, flow to each component cannot be easily inferred from flow measurements at any one point in the system. (See Fig. 4.) The most challenging aspect is flow monitoring at the outlet of the primary pumps or inlet to the core. Because such flowmeters are submerged deep in the pool of sodium, they must be extremely reliable or provision must be made for their easy removal and repair. Experimental Breeder Reactor II (EBR-II) provides a good example of extensive flow instrumentation in the primary system.

EBR-II is an experimental reactor intended to demonstrate the feasibility of the reliable long-term operation of an LMFBR power plant. An important part of this mission is to develop and demonstrate primary-system instrumentation, especially that instrumentation related to measuring reactor coolant flow and temperature. The original flowmeters for the primary-cooling system were of two types,  $\Delta P$  flowmeters (Foster flow tubes) and permanent-magnet flowmeters (PM flow sensors). (See Fig. 5.) Each was considered developmental and both were included to provide diversity and improve reliability. Failures of a number of flowmeters of both types over the 19-year operating history of EBR-II has demonstrated the wisdom of this approach.

## 2.2 Instrumentation Required For Reactor Control

Typical plant control instrument channels for an LMFBR plant are shown in Table I (from Ref. 29). These instruments and associated control functions are discussed below.

### HOT-POOL OPTIONS

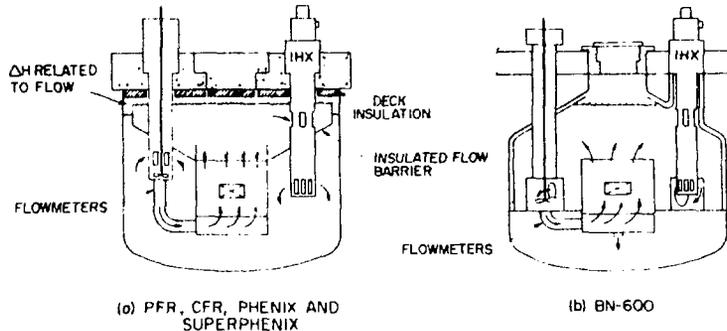

### COLD-POOL OPTIONS

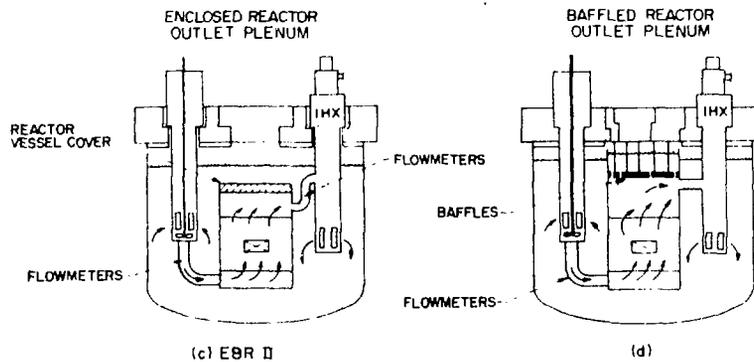


Fig. 4 SEVERAL CONFIGURATIONS OF THE PRIMARY SYSTEM HEAT TRANSPORT PATH IN LMFBRs

The most important measurements in starting the reactor from a subcritical state are the neutron flux level, reactor period, and control rod positions. Neutron flux measurements can be provided by a combination of compensated ion chambers or fission counters. One of the challenges is to provide sensors with sufficient range to provide a linear signal over the eight or ten decades in flux level necessary to provide sufficient coverage for startup. Another related issue is location of the detectors to provide the necessary sensitivity without interfering with reactor operation.

An extremely useful instrument related to these measurements is a reactivity meter, which measures the rate of change of reactor power and its recent history, calculating the instantaneous reactivity in the system. In a sense it can be viewed as a sophisticated period meter, producing an immediate measure of reactivity without having to first reach a stable period (as does a "period" meter).

For operation in the power range, four wide range neutron flux channels and four power range neutron flux channels are typically shared between the plant control and reactor protection system. A major design requirement is that the instrumentation and cabling must withstand the high sodium temperatures or be reliably cooled in special instrument thimbles.

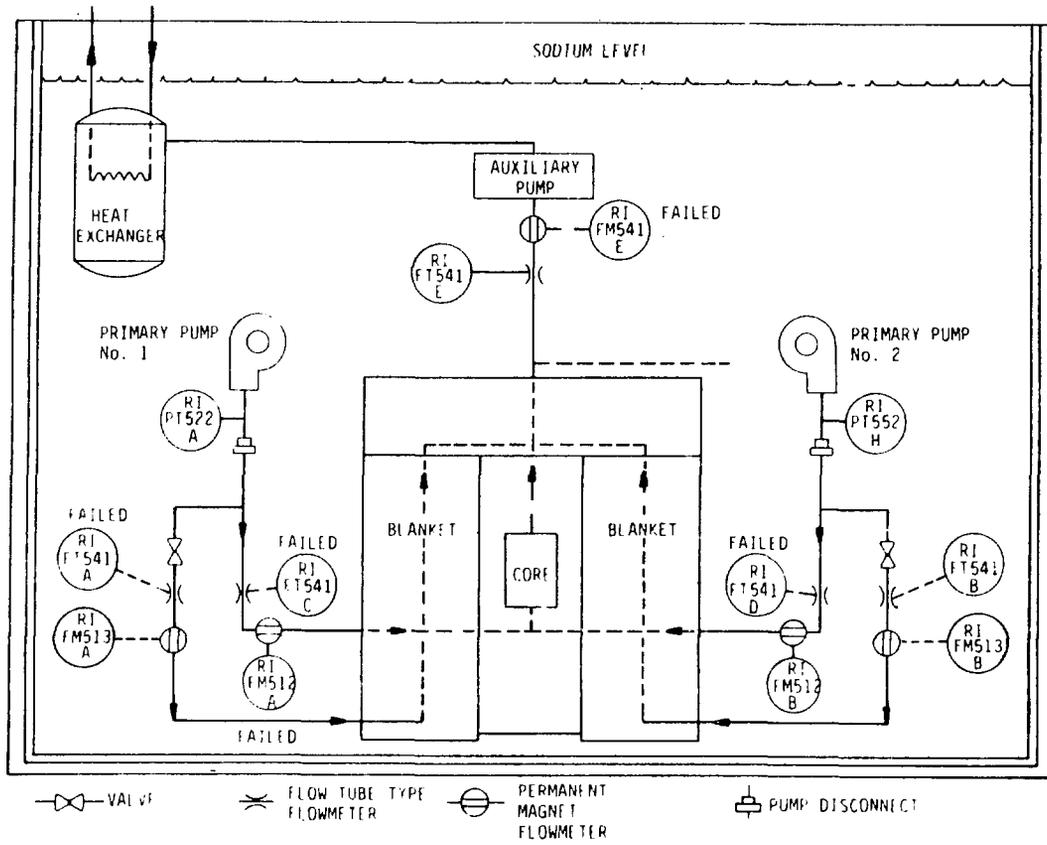


Fig. 5 EBR-II PRIMARY SYSTEM FLOW INSTRUMENTS

TABLE I: PLANT CONTROL INSTRUMENT CHANNELS

Subsystem Name	Parameter Name	Typical No. of Instrument Channels
Reactor Startup	Source Range Neutron Flux	4
	S.R. Sensor Position	4
	Wide Range Neutron Flux	4
	Reactor Period	4
	Rod Position	24
Reactor Power	Power Setpoint	2
	Neutron Flux	8
	Reactor Outlet Temp.	16
	Speed Monitor	4
Primary Sodium Pump Speed	Speed Setpoint	4
	Pump Speed	8
	Power Supply Frequency	8
Intermediate Sodium Pump Speed	Speed Setpoint	6
	Pump Speed	12
	Rheostat Position	12

TABLE I: PLANT CONTROL INSTRUMENT CHANNELS (contd)

Subsystem Name	Parameter Name	Typical No. of Instrument Channels	
Recirculation Water Pump Speed	Speed Setpoint	6	
	Pump Speed	12	
	Rheostat Position	12	
FW Header Pressure	Pressure Setpoint	2	
	Header Pressure	4	
	Feedpump Speed	6	
FW Flow	Drum Level Setpoint	6	
	Drum Level	12	
	FW Flow	12	
	Steam Flow	12	
	FW Valve Position	12	
Steam Header Pressure	Pressure Setpoint	2	
	Header Pressure	4	
	Stop Valve Position	8	
	Throttle Valve Position	2	
	Stop Valve Position	8	
Steam Drum Pressure	Pressure Setpoint	6	
	Drum Pressure	12	
	Bypass Valve Position	24	
Turbine-Generator	Speed Setpoint	1	
	Turbine Speed	2	
	Gen. Frequency	2	
	Gen. Reactor Power	2	
	Gen. Voltage	3	
	HP Turbine First Stage Pressure	4	
	4	4	
Emergency Cooling	o PRACS	Aux. IHX Na Level	6
		NaK Flow	6
		Blower Speed	6
		Damper Position	6
	o IRACS	NaK Flow	6
		Louver Position	6

Flux sensors and cables have, in fact, been developed which can operate reliably without cooling in LMFBR sodium systems. The speed of both primary and intermediate sodium pumps is typically controlled with variable frequency power, either a steam turbine-generator or rectifier-inverters. Instrumentation channels are provided for both speed and frequency, with backup instruments to provide for redundancy in the event of instrument failure.

Circulation pumps, one for each steam generator loop, provide forced circulation of water. Redundant instrumentation is necessary to assure that calibration and servicing of one channel is possible while operating the plant. For a recirculating steam generating system, each generator must have a three element feedwater flow controller to ensure proper control. Redundant measurements of such values as drum level, feedwater-flow, and steam flow must be provided so that the instrumentation may be calibrated and serviced during operation. Flow rates in the steam system are typically measured using venture flowmeters.

Typically, two diverse emergency cooling systems are also provided to assure that sufficient reactor cooling is available during faulted operation. Each system has independent heat exchange loops that transfer their heat to cooling towers and the heat transfer fluid is usually NaK. (NaK has the advantage of a low freezing temperature relative to sodium.) Normally one system uses forced convection cooling while the other one uses natural convection cooling.

Four variables, shown in Table I, determine the state of the emergency cooling systems; (1) sodium level at the entrance to the auxiliary IHX, (2) NaK flow induced with an EM pump, (3) blower speed, and (4) chimney damper position.

### 2.3 Instrumentation For Reactor Safety Systems

Protection of the core from damage in response to plant transients is the goal of the reactor safety system. The task is to first detect an event with the potential for damaging the core and then to take protective action, which may include shutting down the reactor and ensuring continued rejection of decay heat.

Summarized in Table II is an approach to the design of the Commercial Demonstration Fast Reactor (CDFR) Safety System, a U.K. design (from Ref. 20). This approach builds on the very favorable experience of the Prototype Fast Reactor (PFR) at Dounreay. The sensor inputs for reactor shutdown are: (1) High Power Flux, (2) Rate-of-Change of Core Flow, (3) Core Outlet Temperature, (4) Primary Pump Speed, (5) Undervoltage to Primary Pumps, (6) Secondary Pump Speed, (7) Excess Reactivity, (8) Core Outlet Temperature, (9) High Delayed Neutron Signal, (10) Individual Subassembly Outlet Temperature, (11) Acoustic Boiling Noise, (12) Level of Sodium in the Primary Tank, and (13) Reactor Power-to-Flow Ratio.

Likewise, scram-initiation criteria for the French LMFBR Super-Phenix are shown in Table III (from Ref. 21).

Signals for low coolant flow come from a permanent-magnet flowmeter at the outlet of the primary pumps. Subassembly-outlet temperature trips are associated with two chromel/alumel thermocouples per subassembly.

The EBR-II reactor-shutdown system is of interest because of the extensive experience with the system and the evolution in its design that has taken place since 1969. Changes were made both to simplify the shutdown system and to accommodate the failure of several flowmeters in the primary flow circuit.<sup>22</sup> Reactor trips deleted from the shutdown system were (1) high temperature in nuclear-instrument thimble, (2) isolation of the reactor building, (3) malfunction of primary pumps, (4) high delayed-neutron signal, (5) high or low bulk-sodium level, (6) high cover gas pressure or temperature, and (7) high reactor-inlet temperature. These events either did not endanger the reactor or were protected against other functions in the safety system. The present EBR-II safety system functions are listed in Table IV. The favorable impact of these modifications on EBR-II operating reliability were readily apparent.

TABLE II: APPROACH TO SAFETY SYSTEM DESIGN FOR THE CDR

Incident	Trip Initiation	
	Subsystem A	Subsystem B
Loss of electrical power supplies to all primary pumps	Primary pump speed low High rate of change of core flow High Flux/flow ratio High core outlet temp. Power deviation	Primary pump bus bar under voltage. High core outlet temp.
Failure of a coolant duct (Step of 60% reduction in flow)	Power deviation High rate of change in core flow High core outlet temp. High flux flow ratio	High core outlet temp.
Operating rod runaway at reactor startup (Ramp of reactivity of $6 \times 10^4 \Delta K/K$ per second at zero power and 20% flow)	Power deviation High core outlet temp.	Flux inverse period LP/IP flux count High core outlet temp.
Error during refueling removal of absorber rod from a near critical reactor	Inverse period Fuel movement Monitoring system	Subcritical LP/IP flux count Flux inverse period

TABLE III: LIST OF SCRAM INITIATION CRITERIA FOR SUPER PHENIX

Initiation Criteria	Sensor
1. Low-range nuclear - High flux trip - Low period	Helium-filled radiation counter tube
2. Power-range nuclear - Log range . High flux trip . Low period - Linear range . High flux trip . Negative reactivity insertion . Positive reactivity insertion	Fission chamber
3. Primary-pump trip (4 pumps)	Current detection (on each of 3 phases)
4. Reactor flux/Primary flow (P/Q)	Flux: See 3 Magnetic flowmeter
5. Core-inlet temperature (Primary-pump outlet temperature)	Thermocouple
6. Loss of electric power (two buses by channel group)	Undervoltage relay
7. $\gamma$ activity	Ion chamber
8. Detection of fuel-cladding failure	Helium-filled radiation counter tube
9. Earthquake	Speed and acceleration detection
10. Others	Computer
- High core-inlet temperature - Detection of cooling malfunction (by subassemblies group) - High fuel-cladding temperature	Thermocouple  Thermocouple

TABLE IV: EBR-II Reactor Shutdown System (RSS)

<u>Function</u>	<u>Instrument</u>
Seismic Event	Earthquake detector, Vertical and horizontal motion
Flux level high	Fission chambers
Short period	Fission chambers
Subassembly outlet Temperature high	Subassembly outlet Thermocouples
Primary-coolant flow low	Flowmeters Pressure sensors Pump undervoltage
Reactor building Radiation level high	Compensated ion chamber

Monitoring of the reactor flow for safety system use is typically achieved by one or more of the following: 1) measurement of the discharge pressure from the primary pumps, 2) measurement of the flow rate from the primary pumps, and 3) measurement of the pressure at the inlet and outlet of the core (for loop systems). For a pool system, hot-pool level can be incorporated as an additional flow parameter, but its response is slow because of the fluid inertia in the system. Other measurements which have been suggested or used include flow or pressure measurements in individual fueled subassemblies and pump operating parameters such as speed and current.

Because of the large pipes at the discharge from the primary pump, integrated flow measurements are difficult, if not impossible, in the larger plants and relative indications of flow are favored. These include measuring flow in a bypass stream, at the outlet of the primary pumps, for example.

Two diversely designed temperature sensors are required by the Reactor Trip Systems. The sensors should have a response time of about two seconds. One type of sensor which can meet such requirements is a chromel-alumel thermocouple whose leads are contained in a flexible inert gas filled sheath, with the thermocouple junction being attached to the sheath tip.<sup>29</sup> The sheathed thermocouple can be removed and inserted through curved wet thimbles. As discussed later, there has been considerable effort directed to providing reliable fast-response thermocouples for safety system application with only limited success.

Three types of neutron flux monitors are typically used in safety systems. These are source range, wide range, and power range monitors. The source range detectors are monitored by the operator to determine subcritical neutron flux levels in the core. These detectors are retracted from their core location prior to beginning normal plant operations. (Some designs would locate source range detectors in a special thimble in the center of the core).

The wide range and power range detectors provide two diverse measurements of reactor flux to the Reactor Trip Systems as well as to the Plant Control System. Signals sent to the Plant Control System are isolated such that no failure in the PCS can prevent a reactor scram. The power range detector is typically a compensated ion chamber while the wide range detector is a fission counter. Also, as noted earlier, both the sensors and their associated cables have been developed to not require cooling at typical sodium operating temperatures.

#### 2.4 Flow Measurement Techniques

The major types of flowmeters that have been used or considered in LMFBR systems are:

1.  $\Delta P$  flowmeters:

Venturi  
Sharp-edge orifice

2. Magnetic flowmeters:

Permanent magnet  
DC electromagnetic  
Eddy current

3. Ultrasonic flowmeters:

4. Time-of-Flight flowmeters:

Pulsed-neutron activation  
Correlation of temperature noise  
Correlation of magnetic-flowmeter noise

Of the  $\Delta P$  devices, the venturi flowmeter has been the most successful. It is generally accepted as a standard and is used for in-place calibration of magnetic flowmeters. It is, however, potentially large and heavy [typically 1000 lb (454 kg) for a venturi flowmeter of 0.5 m diameter]. To reduce size, a common modification is to shorten the venturi flowmeter and provide fluid "impact" heads around the inside diameter of the Venturi. (See Fig. 6.) Half of the impact heads are positioned facing upstream, and the other half are facing downstream to increase the measured  $\Delta P$ . The  $\Delta P$  is measured by NaK-filled capillary tubes leading to a strain gauge.

Such instruments are very accurate at high flow rates, with accuracy of better than 2% and reproducibility of better than 0.3%. However, their range is poor; typically, they do not provide sufficient accuracy for flow levels below about 25% of maximum.

Sharp-edge orifice plate flowmeters are potentially attractive because their weight is low and they are relatively easy to install or replace. However, erosion of the edge can be a problem; this erosion results in a change of calibration of the flowmeters through at least the initial period of plant operation. They also cause large pressure drops in the flow circuit. They are not, therefore, extensively used.

Magnetic flowmeters take advantage of the electrical conductivity of sodium. They are attractive because their range and linearity are excellent, and their

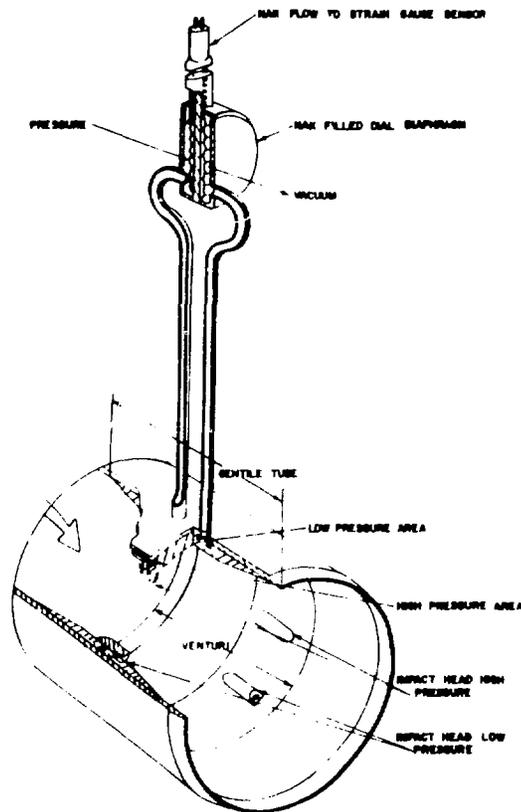


Fig. 6  $\Delta P$  FLOWMETERS FOR LARGE PIPING IN SODIUM SYSTEMS

impact on the piping is minimal. However, they cannot be precalibrated in a water system. The sensor leads must be insulated from the surrounding sodium if submerged in a pool system, and these leads are affected by changes in sodium temperature. Also, they will not work with magnetic metals for piping.

The simplest is the permanent-magnet flowmeter. Its operation is based on the fact that sodium (as an electrical conductor) produces an electric potential when moving across the magnetic field produced by a magnet located on the periphery of the pipe. (See Fig. 7.)

The theory of electromagnetic flowmeters may be derived fairly simply using Ohm's law and the appropriate field equations (Ref. 2).

$$\begin{aligned} \text{Ohm's law } j &= \sigma (E + v \times B); \\ \text{Field Equations } \nabla \times E &= -\dot{B} \\ \nabla \times B &= \mu j \\ \nabla \cdot B &= 0 \end{aligned}$$

where  $j$  = current density  
 $\sigma$  = conductivity  
 $E$  = electric field  
 $v$  = fluid velocity  
 $B$  = magnetic flux  
 $\mu$  = permeability

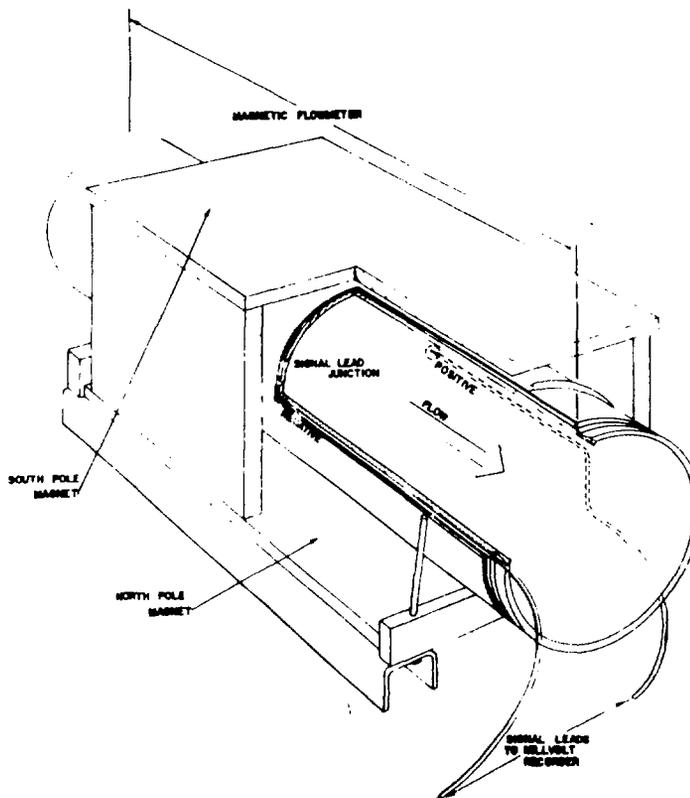


Fig. 7 TYPICAL PERMANENT MAGNET FLOWMETER

for a steady magnetic field  $\dot{B} = 0$  and if one also neglects the influence of currents in the fluid on the magnetic field, one can obtain the result.

$$\Delta v_{EE} = dBv$$

where  $\Delta v_{EE}$  is the voltage across the flowmeter generated by the sodium traveling at velocity  $v$  through a magnetic field  $B$  separated by distance  $d$ .

There are corrections that must be applied to this simple derivation, however, to account for electrical conductivity of the pipe, nonuniform velocity profiles in a circular pipe, and distortion of the magnetic field with increasing flow velocity (giving rise in such terms as the magnetic Reynolds number). Because of these effects, magnetic flowmeters must be calibrated in place. They do, however, provide reliable (and nearly linear) flow signals for LMFBR control and protection.

The magnetic field can be generated by either permanent or electromagnets. Permanent-magnet flowmeters have been used successfully in most of the LMFBR's now in operation or proposed. These flowmeters are not suitable for use in regions of high radiation because of damage to the magnets over long term operations.

Another magnetic flowmeter which has gained some attention, and which avoids the installation of heavy permanent magnets, is an electromagnetic flowmeter commonly called saddle-coil flowmeter. As with a permanent magnet flowmeter, the electromagnet is mounted in the outside of the pipe.<sup>1</sup> The saddle-coil flowmeter has the advantage of being somewhat lighter than permanent magnet flowmeters but is not as suitable for remote locations. It also suffers from the fact that in order to provide linear response with flow in large pipes, the flowmeters must be very long.

Another type of magnetic flowmeter, the eddy-current flowmeter, is of special interest because of its small size, ability to withstand high temperature, and resistance to radiation damage. These characteristics make the eddy-current flowmeter potentially useful for such applications as monitoring flow in individual fueled subassemblies. However, this flowmeter is also highly sensitive to flow turbulence and exhibits some drift in signal with time. Eddy-current flowmeters are now in use at EBR-II, where they measure flow at the outlet of test subassemblies in a special in-core test facility. (See Fig. 8.)

A typical eddy-current flowmeter is made up of three coaxial coils formed on a metallic spool and enclosed in a tube placed axially along the flow path. The center coil forms the primary or excitation coil, and the two coils on either side of the primary coil form the secondary or pickup coils;<sup>1</sup> this flowmeter operates much like a transformer; the primary coil is excited by a high-frequency, low-voltage signal, which induces current in the secondary coils. The magnetic field produced by the primary coil, however, interacts with the moving stream of sodium; this interaction produces electrical eddy-currents, which affect the magnetic field of the primary coil and cause unequal coupling of the two secondary coils. This unequal coupling produces a signal voltage at the output of the two secondary coils.

A disadvantage of the eddy-current flowmeter is that it must be installed directly in the flow stream and is very sensitive to flow behavior at the immediate surface of the flowmeter, giving essentially a point measurement of flow in the pipe. This flowmeter must be carefully calibrated. However, eddy-current flowmeters have been used in a number of applications with good success. An example at EBR-II is in the measurement of flow in a special fuel test facility shown in Fig. 9.

The ultrasonic flowmeter is another type that offers some significant advantages in LMFBR's.<sup>11</sup> This flowmeter depends on measurement of the velocity of acoustic pulses between two transducers. The major benefits of the ultrasonic flowmeter are stability, capability for self-checking, and fail-safe operation. (The flow signal goes to zero for failure of the transducers or related electronics.)

The ultrasonic flowmeter has been used for some time to measure water flow, particularly in open channels. Its basic configuration is shown in Fig. 10 (from reference 1). In the simplest form, two transducers are fixed to the outside of a pipe, mounted on "wedges" located on opposite sides of the pipe and separated along the axis of the pipe. Another option (developed at EBR-II) is to provide a probe within a pipe with transducers located along the axis of the flow stream. The time of travel of acoustic pulses between transducers is changed by the velocity of the flowing sodium, being a function of the sonic velocity in the sodium and the fluid velocity along the path of transmission. When on the outside of the pipe, the transducers are diametrically opposed in order to provide an integration of flow. (Some applications use multiple passes

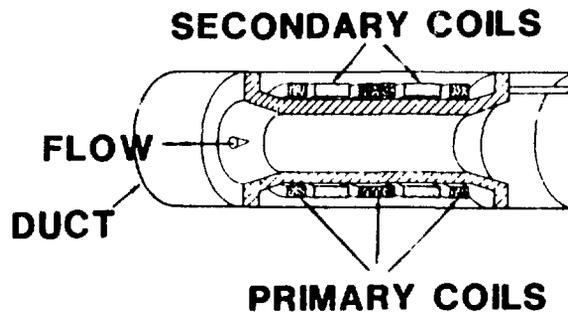
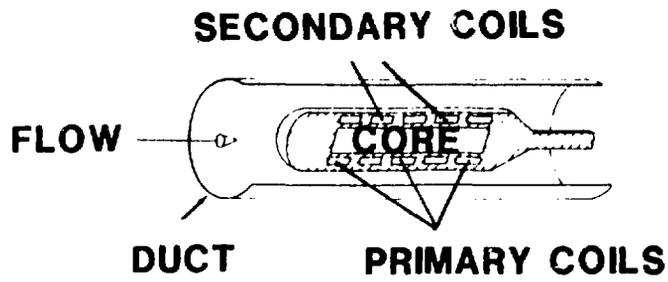


Fig. 8 TWO TYPES OF EDDY-CURRENT FLOWMETERS

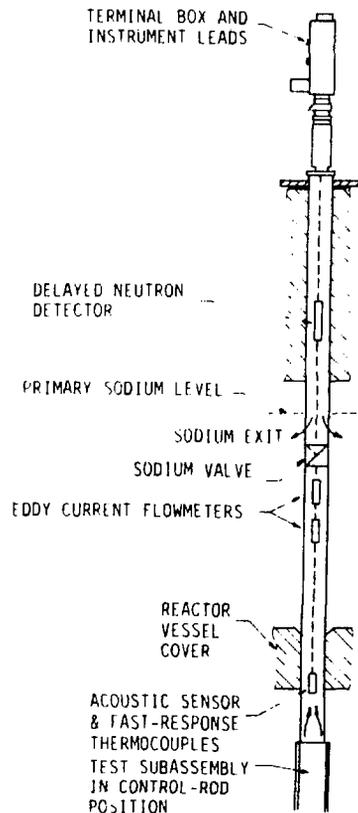


Fig. 9 SCHEMATIC OF THE FUEL PERFORMANCE TEST FACILITIES IN EBR-II

of signals to facilitate integration of the flow signal.) A typical design for a transducer is shown in Fig. 11.

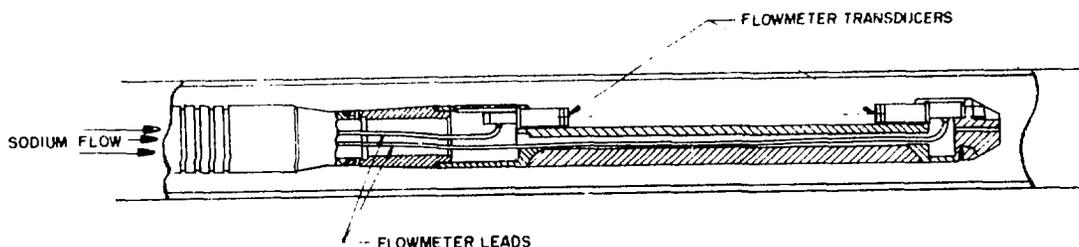
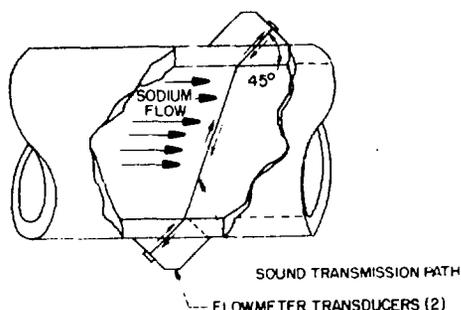


Fig. 10 TWO ARRANGEMENTS FOR ULTRASONIC FLOWMETERS

One of the more successful techniques for measuring time-of-flight flow has been pulsed-neutron activation (PNA), originally developed at EBR-II.<sup>12,13</sup> This technique is basically an extension of radioisotopic tracer techniques that have been in use for many years and is especially attractive because it is an "absolute" measurement (not requiring flow calibration) and requires no penetration of the piping.

As the name implies, a pulsed-neutron source is used to activate nuclei in the fluid, and these are subsequently detected downstream. A weighted transit time is developed to combine with the measured distance between the activation site and the detection site; this provides a mean fluid velocity. Several measurements of sodium and water flow have been made at EBR-II to test and use the technique. Water flows have been measured in the steam system and sodium flow in the intermediate heat-transport system, all with good success.

The instrumentation used for the PNA experiment consists of a gamma-ray detection system, a multiscaler, a pulsed neutron source, and a timing system. A block diagram of the instrumentation system is shown in Fig. 12. The multiscaler provides upper- and lower-level discriminators for rejection of unwanted gamma rays. Timing for the entire system is provided by two pulse generators; this timing allows repetitive pulsing of the systems so that a number of pulses can be used at a selected flow level to improve the counting statistics for the measurement.

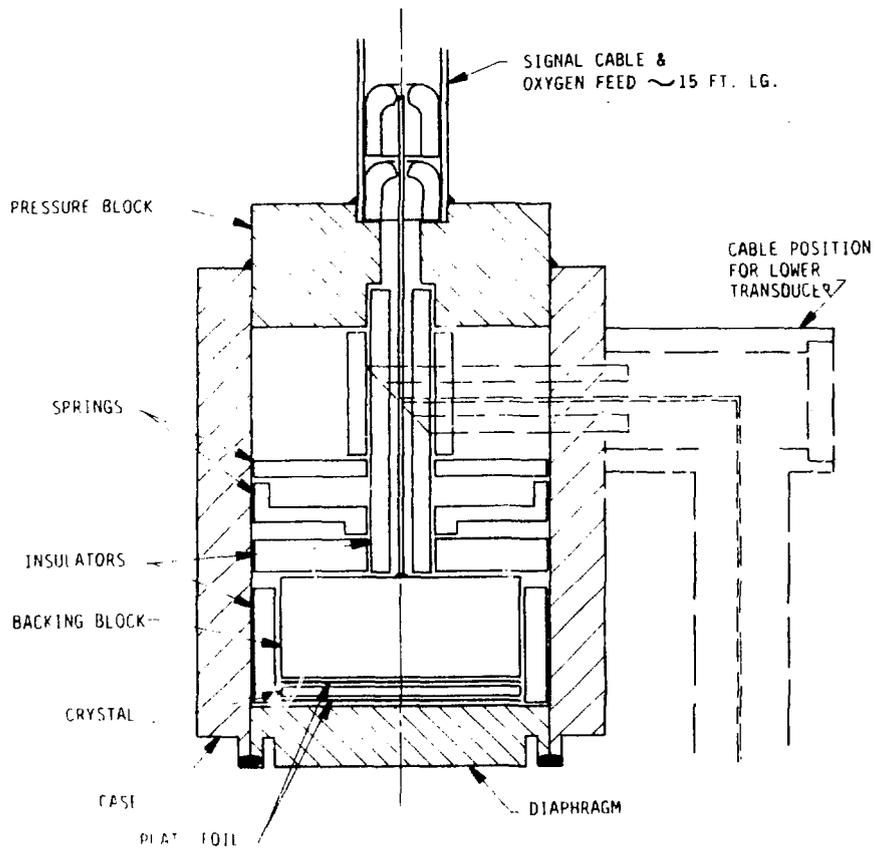


Fig. 11 TYPICAL TRANSDUCER CONCEPT FOR IN-SODIUM ULTRASONIC TRANSDUCERS

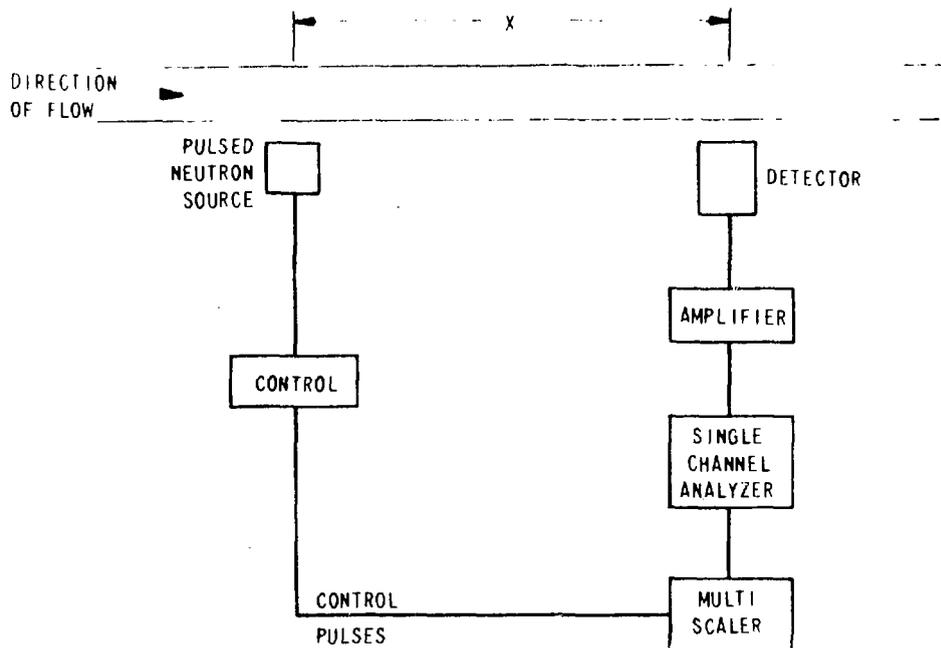


Fig. 12 BLOCK DIAGRAM OF PULSED NEUTRON FLOW MEASURING SYSTEM

The data from the PNA measurement for turbulent flow are reduced using the working relation for the mean reciprocal time

$$1/t = \frac{\sum_{i=1}^I \frac{1}{t_i} C(t_i) \exp(\lambda t_i)}{\sum_{i=1}^I C(t_i) \exp(\lambda t_i)}$$

where  $C(t_i)$  is the number of counts in a multiscaler channel at time  $t_i$ . Errors resulting from this technique are found to be in the range of 0.5 to 1.0%.

There has been considerable LMFBR operating experience with most of the above flowmeter types. The French LMFBR Phenix uses small permanent-magnet flowmeters in a bypass line at the outlet of the primary pumps to measure total flow. However, plant control is on the basis of pump speed. Also, the Soviet Union uses permanent magnets in its largest LMFBR (BN-600) to measure primary flow. In the British reactor PFR, eddy-current flowmeters were initially installed in thimbles in the main primary system pipes, but many of these have failed. Saddle coil electromagnetic flowmeters are used in the IHTS for PFR.

The loop plants likewise have emphasized the use of permanent-magnet flowmeters. The U.S. plants, FFTF and CRBR, and the German plant SNR 300 use permanent-magnet flowmeters in both the PHTS and IHTS, and venturis are installed in the IHTS for flow calibration. The FFTF flowmeters were calibrated in place with pulsed-neutron activation, as were the EBR-II flowmeters in the IHTS.

The Japanese use an electromagnetic flowmeter in the primary-sodium system for the JOYO plant. For their next plant, MONJU, they are considering the use of ultrasonic flowmeters.

The PNA technique was used very successfully to calibrate in-place flowmeters in the U.S. At EBR-II, the PNA method was used to measure the secondary-sodium flow at seven different flow levels. Figure 13 shows a typical count history for the secondary-flow measurement. Table V displays the data for the Foster and electromagnetic flowmeter compared to the PNA results at EBR-II. The relatively low uncertainties in flow may be seen.

### 3. IN-CORE AND OUT-OF-CORE MEASUREMENTS IN LMFBRs

The LMFBR community has given much attention to thermal-hydraulic monitoring of individual fueled subassemblies.<sup>4,14,15</sup> Of interest are temperature, flow, and acoustic measurements to verify that no local disruption of flow is occurring. This has been an important consideration for reactor safety ever since the flow blockage and melting of fuel occurred in some subassemblies of the FERMI reactor. However, safety experiments conducted over the last 10 years have lessened concerns over this question, showing that local failures within subassemblies will not propagate to surrounding subassemblies.

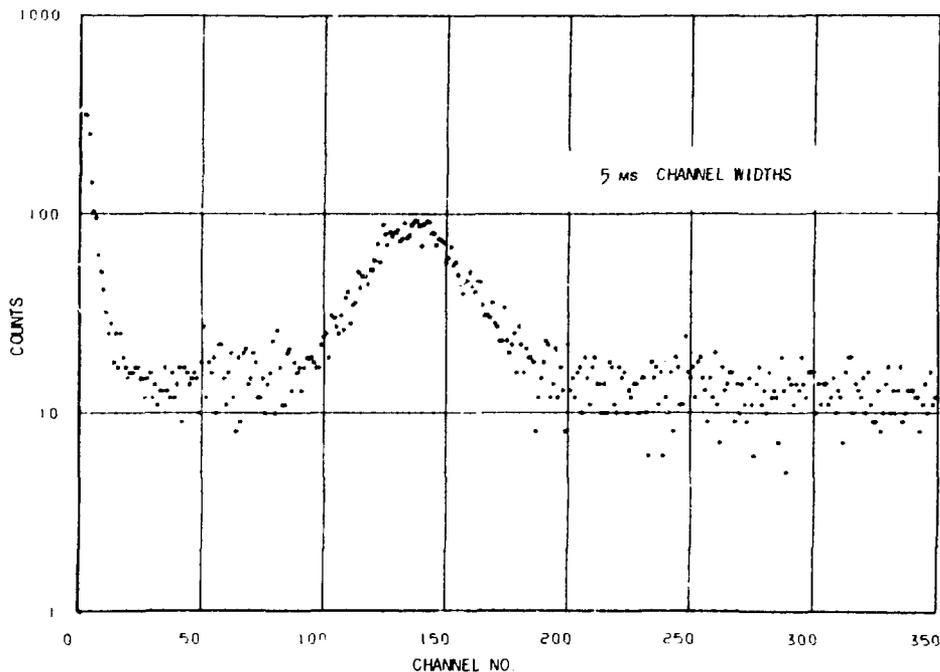


Fig. 13 MULTISCALE R DATA FROM MEASUREMENTS OF SECONDARY SODIUM WITH FLOW LEVEL AT NOMINAL 90% OF FULL FLOW

### 3.1 Subassembly Temperature Monitoring

Monitoring the outlet-sodium temperature of fuel subassemblies is reasonably easy and is a standard feature of most LMFBR plant designs. Typically, thermocouples are chromel/alumel and are located in wells 2 to 4 cm above the outlet of individual subassemblies. These wells can either be dry (filled with argon or helium gas) or wet (filled with sodium). Wet thermocouple wells have the advantage of improved response time (thermal time constants of between 0.5 and 1.5 s) but are much more difficult to replace because of contamination by sodium.

Three major types of thermocouples may be identified.<sup>27</sup> In the first, the hot junction is insulated from the metal sheath by materials such as MgO or  $Al_2O_3$ . The heat is transferred to the hot junction by heat conduction through the steel and insulating material. Their time response is therefore relatively long.

The second major type puts the hot junction in direct contact with the metal sheath, eliminating the thermal resistance through the electrical insulation. The time constant is therefore relatively short.

Table V (From Ref. 13)

Flow Rates of Secondary-Sodium System in EBR-II  
(Sodium at 577 K)

Nominal Secondary-Sodium System Flow Level (%)	Flow Rate (M <sup>3</sup> /s)			Relative Neutron Generator Output <sup>c</sup>	PNA Flow Velocity (m/s)	Uncer- tainty (%)
	EM Flowmeter <sup>a</sup>	Foster Flowmeter <sup>b</sup>	PNA			
0	0.0	0.0	0.0	0.0	0.0	---
10	0.0382	0.0398	0.0390	1.057	0.496	3.3
20	0.0752	0.0759	0.0770	1.029	0.980	2.1
40	0.1497	0.1457	0.1457	0.950	1.940	2.1
60	0.2253	0.2189	0.2320	0.972	2.952	2.1
80	0.3009	0.2982	0.3136	1.029 <sup>d</sup>	3.990	?
90	0.3376	0.3397	0.3595	1.017	4.575	1.9
95	0.3565	0.3606	0.3830	0.984	4.874	1.9

<sup>a</sup>Determined from: flow = 0.006765 x mV from Table V.

<sup>b</sup>Determined from: flow = 0.2890 x voltage of Table V.

<sup>c</sup>Sum of output monitor indications divided by total number of pulses normalized to the average level of 5.092 per pulse.

<sup>d</sup>Voltage on neutron generator increased at this point for the rest of the test.

The most rapidly responding TC is a type called an intrinsic thermocouple. The basic feature of this type is the formation of the hot junction by the contact with the surrounding sodium. The time constant for these thermocouples is therefore very short. Their construction is shown in Fig. 14 (from reference 27). The inner wire is made of the same material as the metal sheath with both connected at the top end. The cold junction can be at the wall (version A) or at an open element filled with sodium (version B). If an intrinsic thermocouple is confined with a more conventional thermocouple well, both a "steady state" and a fluctuating temperature measurement can be obtained.

When a flow blockage occurs, the decrease in flow causes an increase in the subassembly's sodium-outlet temperature. However, this increase in temperature may be hidden by flow from surrounding subassemblies because cross flow influences the temperature reading. This, coupled with the fact that a "significant" flow blockage can occur with only a moderate rise in measured outlet temperature, limits the value of sodium-outlet temperature as an indicator of flow blockage in a subassembly. For example, a nonporous planar blockage covering 50% of the flow area at the midplane of a subassembly fuel bundle would

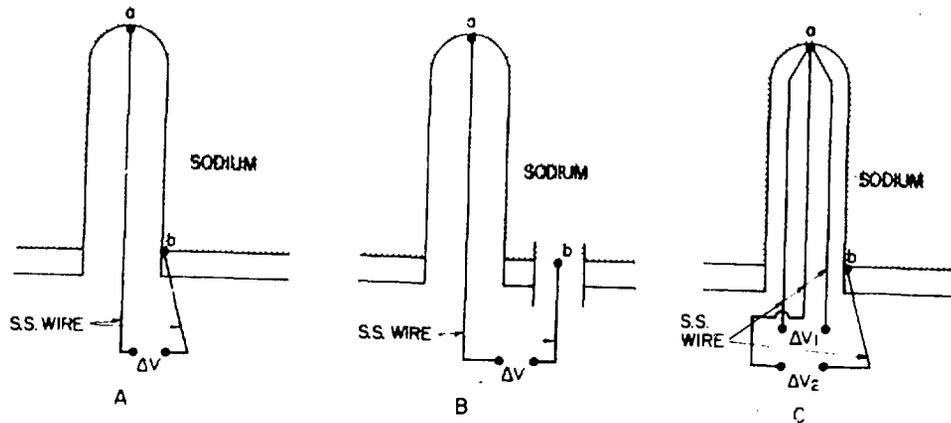


Fig. 14 SEVERAL APPROACHES TO DESIGN OF INTRINSIC THERMOCOUPLES

reduce subassembly flow by only approximately 5%, too small to be reliably detected by a change in outlet temperature. Instead, much attention has been given to temperature noise, which is increased with the turbulent flow associated with a partial flow blockage. Several theoretical models have been advanced to predict the magnitude and character of temperature noise in single phase fluids. Also, a number of out-of-reactor tests have been conducted to measure temperature noise, and agreement between theory and test has been reasonably good.<sup>1,25,26</sup> (See Fig. 15.) Because of the high frequency of the temperature noise, however, fast-response thermocouples (time constants of 200 ms or less) are required for the reliable measurement of temperature noise associated with partial flow blockage. It is not clear that such thermocouples can be developed for routine use in commercial LMFBR's.

As the extent of flow blockage increases, the measured sodium-outlet temperature may actually drop and temperature noise may decrease because of mixing with flow from surrounding subassemblies. The measurement of sodium-outlet temperature in subassemblies is, therefore, of limited value for indicating extensive flow blockage, although it can be reliable during the early stages of flow blockage formation.

As noted above, in order to detect temperature noise, it is necessary to provide thermocouples with very short time constants (200 ms or less). Typical chromel-alumel thermocouples have time constants in the range of 5-10 s in dry wells and 0.5 to 1.0 s in wet (sodium-filled) wells.<sup>3</sup> Special designs, such as the "coaxial" thermocouple developed in the UK, can result in time constants for wetted thermocouples in the 40-50 ms range.<sup>16</sup> The emphasis in the US for fast response TC's has been on more conventional design approaches, with the major problem being the development of reliable welding techniques to join extremely

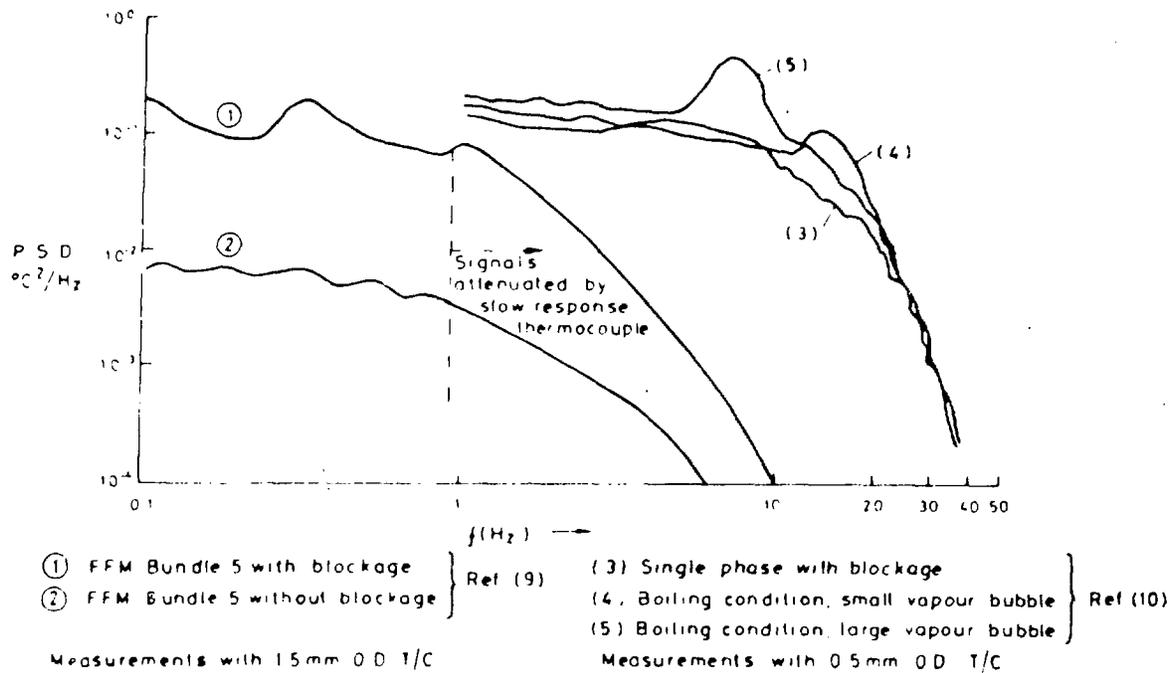


Fig. 15 POWER SPECTRAL DENSITIES OF TEMPERATURE NOISE OBTAINED DURING OUT-OF-PILE BLOCKAGE EXPERIMENTS USING TWO THERMOCOUPLE DESIGNS (from reference 1)

fine TC wires at the junction. The EBR-II experience with fast response TC's in test assemblies has indicated the need for more work in this area.

Sodium-outlet thermocouples for subassemblies in the Super-Phenix reactor are of two types; these are (1) replaceable conventional thermocouples in dry wells of special designs which should result in time constants of  $\sim 2.5$  s and (2) two intrinsic sodium/steel thermocouples with time constants on the order of  $\sim 1$  ms. The performance record of the chromel-alumel thermocouples has been good, but the intrinsic sodium/ steel thermocouples have not been extensively used because of difficulty in interpreting signals.

### 3.2 Acoustic Monitoring

Because of the difficulty of reliably detecting serious flow blockage or local sodium boiling with outlet thermocouples, attention has been directed to the use of individual flowmeters in subassemblies and the use of acoustic sensors to detect boiling.<sup>6,17</sup> A major problem with using acoustic sensors to detect boiling in an LMFBR system is the prediction of the acoustic coupling between the source of the noise and the detector. Also, the strength and character of the signal itself is sensitive to many details of the boiling process (such as dimensions of the sodium-vapor bubbles, degree of subcooling, size of subassembly). To detect boiling accurately also requires a system with relatively low background noise, which may mask acoustic signals due to boiling.

Establishing the feasibility of acoustic monitoring to detect in-subassembly boiling requires in-reactor experiments to characterize background noise, as

have been conducted at the PFR, EBR-II, and elsewhere.<sup>17</sup> Results from boiling experiments indicate an optimum detection bandwidth of from 80 to 300 kHz. A problem is that cavitation from pumps can generate an acoustic signal very similar to that associated with boiling; this problem must be precluded in pump design.

Early efforts in acoustic monitoring attempted to adapt low-temperature acoustic sensors to LMFBR application through the use of wave guides. Unfortunately, the wave guides distort the frequency spectrum and tend to enhance the background noise of the reactor (because of mechanical coupling with structures). The more recent development and testing of high-temperature monitors has alleviated this problem. At EBR-II, acoustic monitors using lithium niobate transducers have been tested and used productively in mechanical operations with the core.

Lithium niobate ( $\text{LiNbO}_3$ ) piezoelectric devices are suitable for liquid sodium use primarily because of their capability to withstand high temperature. However, these are vulnerable to loss of oxygen to the sodium over time and either must be supplied a source of oxygen, Fig. 11, (via a capillary tube) or by careful encapsulation in a noble metal such as platinum. The most common approach is to provide oxygen via a capillary tube.

### 3.3 Passive Measurement of Subassembly Temperature

Another aspect of LMFBR instrumentation that is important is in-core measurement of subassembly temperature by passive means. One of the most successful techniques involves the use of a thermal-expansion-difference temperature monitor (TED), also developed at EBR-II.<sup>18</sup> A TED, basically a small capsule filled with sodium, is plastically deformed as the sodium temperature increases (Fig. 16) because the thermal-expansion coefficient of sodium is greater than that of the stainless steel of the capsule. The TED can be calibrated quite accurately out-of-core by measuring its change in volume as a function of temperature. Using TED's, temperature distributions in individual fuel subassemblies and across the core can be measured to within  $\pm 5^\circ\text{C}$ .

An important modification of this device is a gamma-expansion-difference monitor (GEDM)<sup>19</sup> which measures the rates of heat deposition by gamma rays. These measurements are important for assessing the heat load on structural components in the core and for interpreting the results of irradiating structural materials. The GEDM is essentially a TED with a gamma-absorbing material within it. (See Fig. 17.) If the heat-transfer characteristics of the device are known, the rate of gamma-energy deposition can be determined from the temperature of the device. The maximum temperature the GEDM experiences in the reactor core is directly related to its measured volume change, in the same way as the TED's.

### 3.4 Pressure Measurement Instruments

Because of the use of liquid metals as heat transfer media is rare in industrial applications, standard instruments for these systems are not available as off-the-shelf items. In some instances, existing instrument designs have been modified for use in liquid metal systems; in other instances, the unique properties of liquid metals have been used to develop new types of instruments.

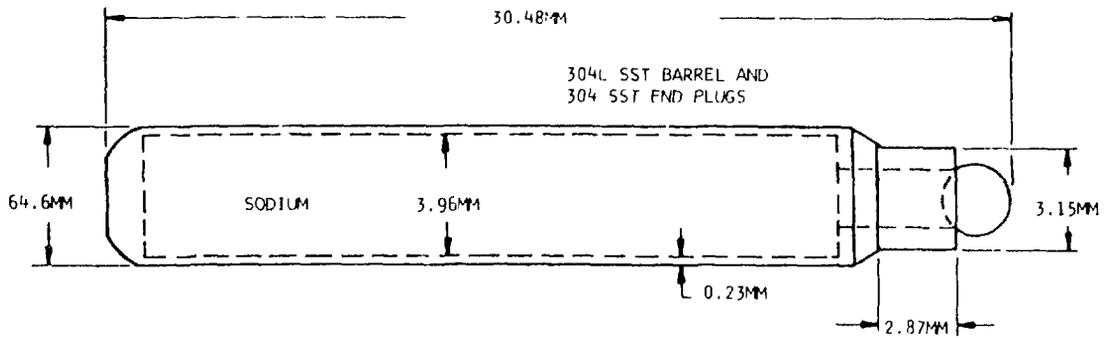


Fig. 16 A TYPICAL EXPANSION DIFFERENCE (TED)  
TEMPERATURE MONITOR USED AT EBR-II

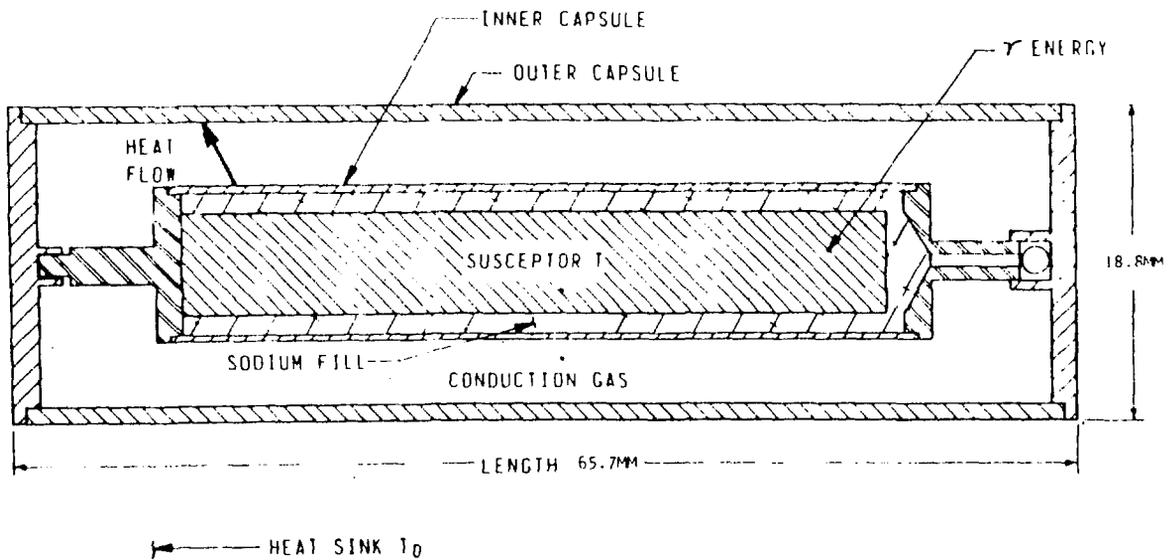


Fig. 17 A TYPICAL GAMMA EXPANSION DIFFERENCE  
MONITOR (GEDM) USED AT EBR-II

There are three main types of elastic pressure elements: (1) metallic diaphragm, (2) bellows, and (3) bourdon tube using NaK filled pressure transducers. Disadvantages of NaK-filled pressure transducers are the difficult installation caused by the one-piece unit, and the instability of the electrical strain gauge. Strain gauges are sensitive to temperature changes and drift over long periods of time. These characteristics make frequent recalibration necessary. However, because of the very small displacement of NaK in this system, the pressure instruments are capable of very high degrees of accuracy; accuracy is approximately 1% of full-scale deflection.

#### 4. STEAM GENERATOR INSTRUMENTATION

LMFBR steam generators must be designed to ensure the complete separation of sodium and water. However, if leaks do occur, they must be detected as early as possible to avoid further damage. Two primary means of detecting such leaks have been pursued; these are the acoustic detection of leaks and the detection of the hydrogen and oxygen that results from the sodium-water reaction. Of these, hydrogen-leak detection has been the most successful and has gained the widest application. An example of the performance of this method is in the detection of the recent series of small steam-generator leaks at the French plant Phenix; all these leaks were reliably detected with hydrogen-leak detectors and protective actions were taken.

##### 4.1 Hydrogen-leak Detectors

The hydrogen-leak detectors work by the diffusion of hydrogen through a nickel membrane to a detector, which is commonly an ion pump that maintains a vacuum in the system. (See Fig. 18). The hydrogen-leak detector system at EBR-II consists of a sodium-piping system that draws sodium past a nickel membrane, a leak-detector system, and the associated electronics and controls.<sup>23</sup> The detection system requires only one penetration into the sodium pipe and is located within the EBR-II steam generating system as shown in Fig. 19.

The rate of diffusion of hydrogen across the membrane is affected by the sodium temperature, which must be controlled if reliable results are to be obtained. (Temperatures are maintained at 735°K). The nickel membrane is 0.25 in. (6.35 mm) thick and the ion pump maintains a vacuum of  $10^{-6}$  to  $10^{-8}$  torr. The most critical mechanical feature of design is the weld of the nickel membrane to the inconel transition piece and the inconel to the stainless steel piping. The early experience with these detectors at EBR-II was poor, with leaks occurring at the weld of the transition piece to the stainless steel. That problem has been corrected, however, and the units have operated very reliably since 1976. They are a standard feature of EBR-II's operating instrumentation, providing alarm for operation action in the event of a leak in the EBR-II steam-generating system. No such leaks have occurred in EBR-II's 19 years of operation.

The response time of hydrogen-leak detectors is relatively fast, depending on hydrogen concentration (related to the size of the leak), location of a leak, and velocity of the flowing sodium. For EBR-II, calculated response times (considering small or moderate leaks) range from 30 s to several minutes. There has been no experimental verification of calculated response times, although such tests could conceivably be conducted by injecting a small amount of water into the sodium stream.

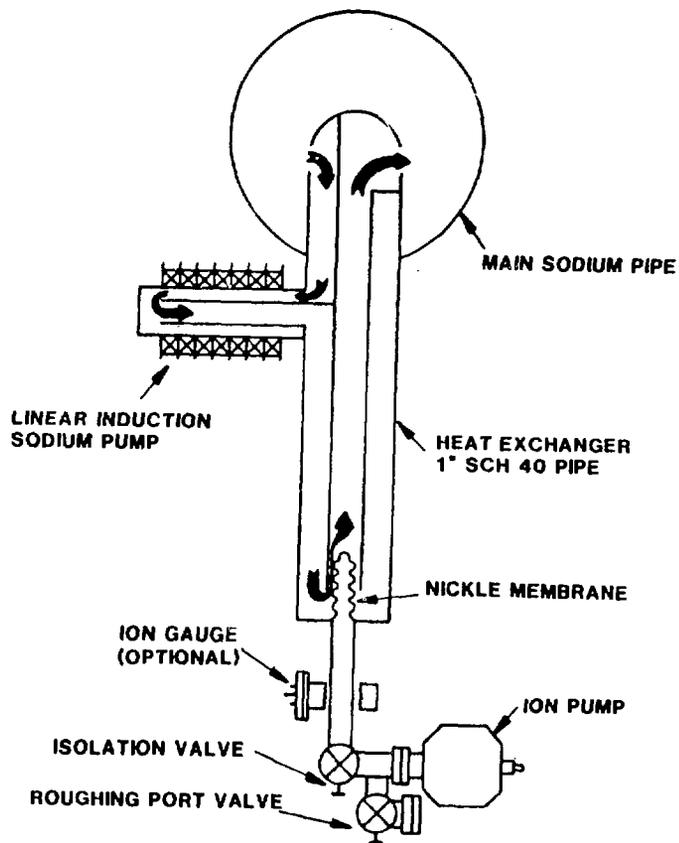


Fig. 18 SCHEMATIC OF HYDROGEN LEAK DETECTOR USED AT EBR-II

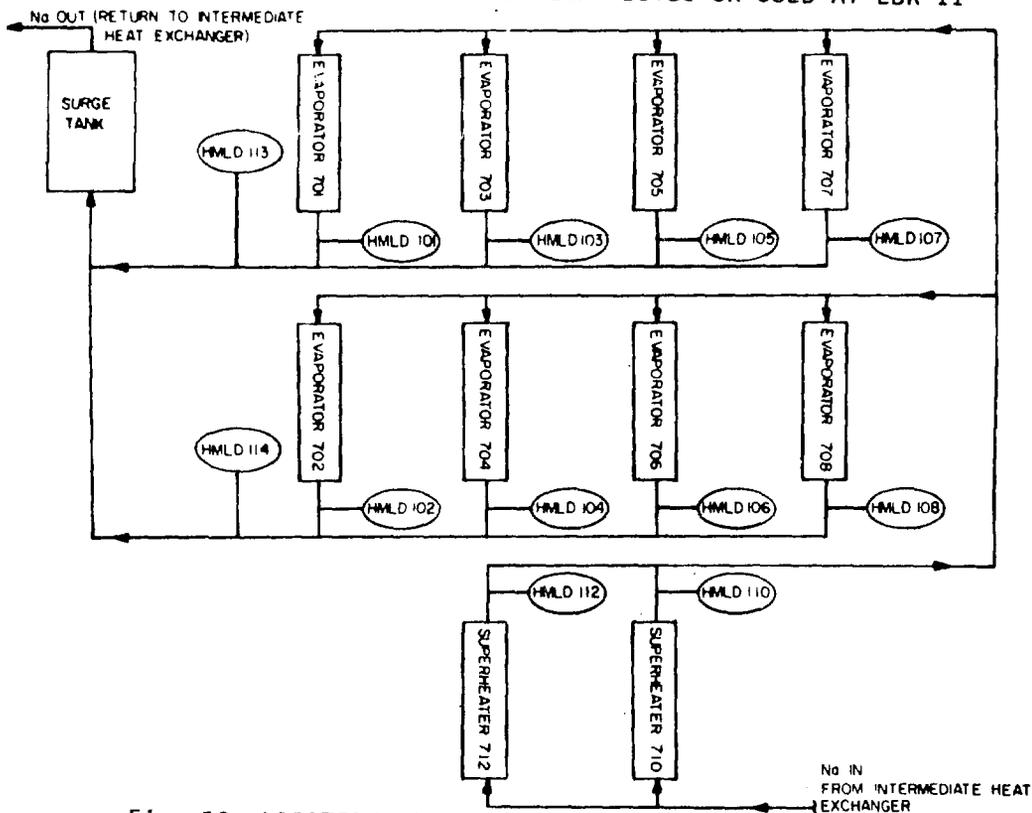


Fig. 19 LOCATION OF HYDROGEN METER LEAK DETECTORS IN THE EBR-II STEAM GENERATING SYSTEM

The experience of these detectors at EBR-II and similar systems at other LMFBR's gives confidence in the ability to reliably detect sodium or water leakage in time to avoid extensive damage. An interesting proposal to detect leakage of either sodium or water before they come in contact is to provide duplex tubes (one tube within the other) and flooding the interface with helium. Sodium vapor or steam could be detected if it migrated from either side by monitoring the helium.

#### 4.2 Acoustic Leak Detectors

Acoustic leak detectors for LMFBR steam generators have the advantage of being able to locate the leak, as well as to detect it. They depend upon detection of the noise associated with steam exhausting through a leak into the sodium system. Typically, leaks as small as 0.06 mm equivalent diameter can be detected.<sup>28</sup>

The operating frequency range for the system is typically 1 kHz to 10 kHz, with the signal amplitude decaying inversely as the distance from the source.<sup>28</sup> In order to provide adequate resolution for location of a leak, several hundred accelerometers may be required for a typical steam generator. They must be arranged in a preset pattern to allow for location of leaks, based upon signal processing techniques not unlike that used for sonar systems. A major requirement in development of the systems is reduction of background noise where possible, as well as careful characterization of background noise to establish sensitivity and alarm limits.

The method of attachment of accelerometers to the vessel wall is important in ensuring a linear response of the instrument over the desired frequency range and in providing sufficient electrical isolation to avoid ground loops. A typical system is shown in Fig. 20 (from Ref. 28). The accelerometers themselves are piezoelectric transducers, which respond with an electric potential directly proportional to force (acceleration) applied. Because of the large number of sensors and the complexity of processing signals in order to locate the leak, signals must be processed using minicomputers and reasonably sophisticated software. Successful tests have been run both in water models and in actual LMFBR plants.

The major objective of in-plant tests has been to characterize background noise and to demonstrate that the systems can be operated reliably. Background noise originates from sodium flow, steam flow, boiling and mechanical noise from pumps. Such tests have been conducted on the EBR-II steam generators, with results agreeing well with those obtained in laboratory tests. The feasibility of acoustic leak detection systems has been established.

#### 5. MEASUREMENT OF IMPURITIES IN SODIUM HEAT TRANSPORT CIRCUITS

As mentioned earlier, the measurement of impurities in sodium heat-transport circuits is important because of the potential for corrosion as well as plugging of flow passages. This latter characteristic, however, can be used to advantage in an instrument called a plugging-temperature indicator (PTI)<sup>24</sup>. Basically, this instrument consists of a small passage through which sodium can be directed. As the temperature of the sodium is reduced, impurities come out of solution and plug the flow passage. The temperature at which this occurs is

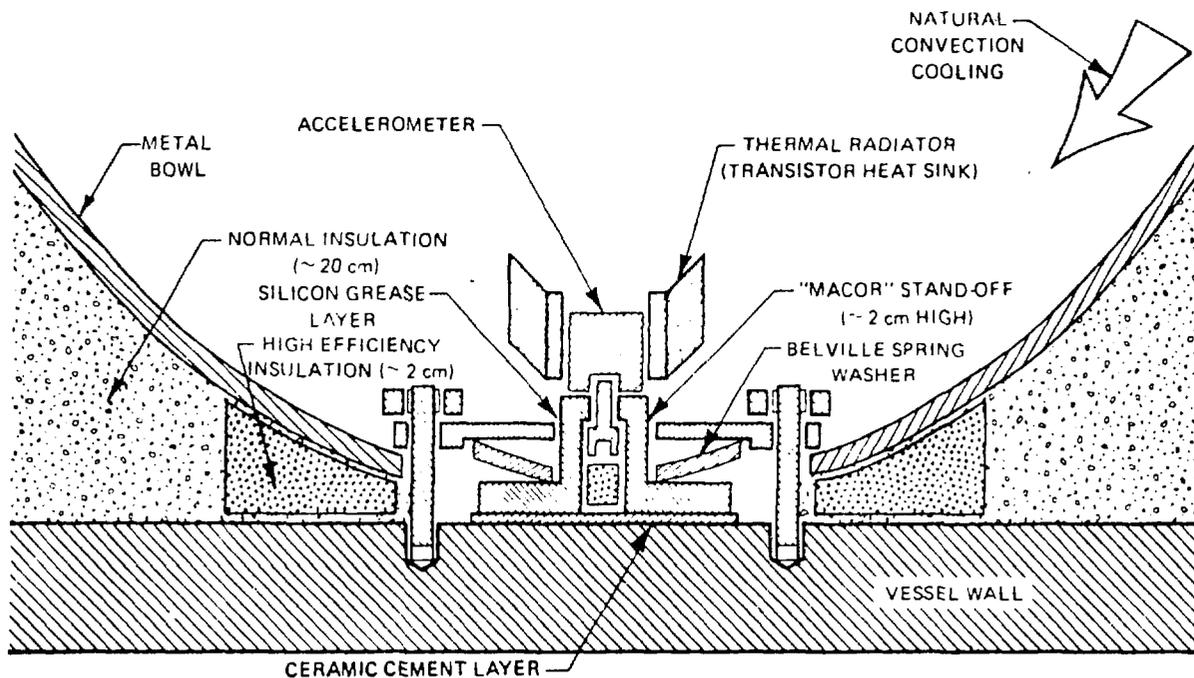


Fig. 20 TYPICAL MOUNTING OF AN ACOUSTIC DETECTION SYSTEM MONITOR TO AN LMFBR STEAM GENERATOR

called the plugging temperature and can be related to the level of impurities in the sodium.

The original PTI's at EBR-II were the fluted-valve type. The plugging element was a globe-type valve with grooves cut in the stem. The valve was opened in the standby condition to dissolve the previously deposited plug and to prepare for the next plugging determination (plugging run). During a plugging run, the valve was closed and sodium was forced to flow through the stem grooves.

A plugging run was made by cooling the plugging valve until a gradual flow decrease occurred, or until the temperature reached about  $110^{\circ}\text{C}$ . If a gradual flow decrease occurred, the plugging temperature was reported as the temperature at which this decrease started. If no loss of flow occurred before the temperature reached  $110^{\circ}\text{C}$ , then the plugging temperature was reported as  $< 110^{\circ}\text{C}$ .

The fluted-valve PTI's in EBR-II were replaced in 1977 by a new design, the heart of which is a  $60\text{-}\mu$  filter element.<sup>24</sup> This element is located at the bottom of a combination sodium-to-sodium and sodium-to-air heat exchanger. The heat-exchanger assembly is 1.88 m (74 in.) long, excluding the air-cooling duct. Other dimensions are shown in Fig. 21.

As shown in Fig. 19, sodium flows down the outer annulus of the heat exchanger assembly. At the bottom the stream divides. One stream passes through the filter then flows up through an intermediate annulus, and the other stream bypasses the filter and flows up a center tube.

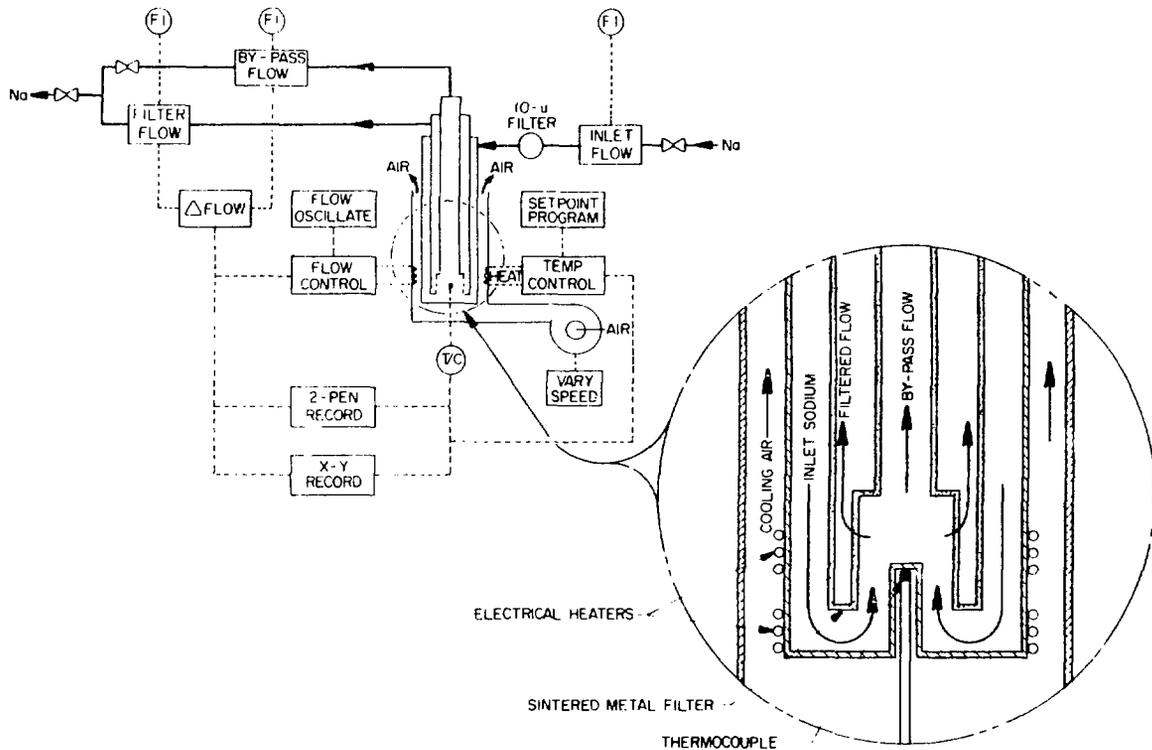


Fig. 21 SCHEMATIC OF A FRIT TYPE PLUGGING TEMPERATURE INDICATOR AT EBR-II

The new PTI has proved to be a very sensitive device for measuring plugging temperatures in the EBR-II primary- and secondary-sodium systems. The PTI normally indicates the presence of a slow-plugging and a fast-plugging material in both systems. The slow-plugging material normally plugs in the range of 170-180°C and is at present unidentified. The fast-plugging material normally plugs in the range of 120-140°C and correlates very well with the sodium hydride saturation temperature.

## 6. SUMMARY

The unique characteristics of sodium have required development of much new instrumentation. The experience that has accumulated in the industry demonstrates that LMFBR's are viable, efficient and safe power producers for which reliable instrumentation has been provided. One of the most difficult instrument challenges, detecting leakage in steam generators, has been successfully met with development and testing of hydrogen leak detectors. Likewise, the performance of permanent magnet flowmeters has been shown to be reliable and then have gained wide application in sodium systems. To gain the benefits of reduced weight and more flexibility, development of ultrasonic flowmeters is now being emphasized.

As the design of LMFBR power plants has been improved and confidence gained in their operation and safety, less emphasis is being placed on development of such instrumentation as fast-response thermocouples at the outlet of core subassemblies or acoustic monitors to detect boiling. The emphasis is on those instruments necessary to provide reactor control and surveillance for

efficient operation. Therefore, magnetic and ultrasonic flowmeters are being extensively used as are "standard" chromel/alumel thermocouples and hydrogen leak detectors in sodium/water systems.

#### REFERENCES

1. Hughes, "LMFBR Instrumentation: A Review of Problems and Recent Progress," Atomic Energy Review 18 3 (1980) 661
2. Baker, R. C., "E.M. Flowmeters for Fast Reactors," Proj. Nucl. Energy 1, 1 (1977) 41.
3. Muller, St., Thum, G., "Performance of Permanent Magnet Flowmeter Probes for Instrumentation of LMFBR's," Proceedings, Second International Conference on Liquid Metal Technology in Energy Production, Conf-800401-P1 (April 1980) 4-44
4. Argous, J. P., et al., "Temperature Measurements at the LMFBR Core Outlet," Second Int. Conf. on Liquid Metal Tech. in Energy Production, Conf-800401-P1 (April 1980) 4-52.
5. McKnight, J., et al., "The Application of Ultrasonic Technology Under Sodium," Ibid, pg 4-16.
6. Argous, J. P., et al., "Immersed Acoustical Transducers and Their Potential Uses in LMFBR's" Ibid, pg 4-23.
7. Hanbold, W., Jung, J., Schillings, K. L., "Monitoring and Control of Impurities in Sodium Systems," Ibid, pg 15-1.
8. Osterhout, M. M., "Operating Experience with On-line Meters at Experimental Breeder Reactor-II (EBR-II), Ibid, 15-9.
9. Greene, D. A., Ahlgreen, F. F., Meneely, D., "Acoustic Leak Detection/Location System for Sodium Heated Steam Generators," Ibid, 21-9.
10. Foster, G. A., et al., "Sodium Flowrate Measurement and Calibration Techniques Being Developed at ANL for Large LMFBR Pipe Applications," IAEA Specialists Meeting, Warrington, Jan. 1976, 579.
11. Araki, H. et al., "Flow Measurement by Ultrasonic Method," Liquid Metal Technology in Energy Production (Proc. Int. Conf. Champion, USA, 1976) 802.
12. Larson, H. A., et al., "Flow Measurement in Sodium and Water Using Pulsed-Neutron Activation: Part 1, Theory," Nuclear Technology Vol. 57, May 1982.
13. Price, C. C., et al., "Flow Measurement in Sodium and Water Using Pulsed-Neutron Activation: Part 2, Experiment, Nuclear Technology, Vol. 57, May 1982.
14. Burton, E. J., et al., "The Development of Techniques for the Surveillance of LMFBR's," Progress in Nuclear Energy, Vol. 1 (1977).

15. Ogino, T., "Feasibility Study of Local Core Anomaly Detection by Use of Temperature and Flow Fluctuations at LMFBR Fuel Subassembly Outlet," Proc., Int. Mtg. on Fast Reactor Safety Technology, Seattle, Aug. 1979.
16. Thompson, A., Fenton, A. W., "A Fast-Response High-Integrity, Coaxial MI Thermocouple, VK AEA Report ND-R-116(R) (March 1978).
17. Macleod, I. D., Cutling, E., Taylor, C. G., "Acoustic Detection of Boiling in LMFBR's: An Estimate of Sensitivity Derived From Experiments During the Commissioning of PFR," Progress in Nuclear Energy, Vol. 1, pp. 69 to 485 (1977).
18. Wilkes, C. W., Cerchione, J. D., "Manufacture and Use of Thermal-Expansion Difference Temperature Monitors," Trans. Am. Nucl. Soc. 38, p. 676 (June 1981).
19. Price, C. C., English, P. N., Courtney, J. C., "An Improved Design for an Active Calorimeter," Trans. Am. Nucl. Soc. 27, p. 844 (1977).
20. Bradley, D., MacDonald, D. R., "The Design of the CDFR Reactor Automatic Shutdown System," Proceedings, Intl. Mtg. on Fast Reactor Safety, Seattle (1979).
21. Mangnon, B., et al, "Safe Shutdown Systems Design of the Creys-Malville Fast Neutron Plant," *ibid.*
22. Sackett, J. I., "Safety Philosophy in Upgrading the EBR-II Plant Protection System," *Ibid.*
23. Osterhout, M. M., "Operating Experience with On-line Meters at EBR-II," Proc. 2nd Int. Conf. on Liquid Metal Technology in Energy Production, Richland, Wash., (1980).
24. Olson, W. H. and Washburn, R. A., "EBR-II Experience with Frit-type Plugging Temperature Indicators," (*Ibid.*).
25. Sides, W. H. Jr., et al., "Temperature Noise Analysis and Sodium Boiling Detection in the Fuel Failure Mockup," ANS/ENS International Meeting on Fast Reactor Safety and Related Physics, Chicago, October 1976.
26. Krebs, L., Weinkotz, G., Detection of Local Boiling in LMFBR Subassembly by Temperature Fluctuations Analysis at the Outlet, Prg. Nucl. Energy 1 2-4 New Series (1977) 507.
27. Benkert, J., Mika, C. Raes, K. H., Stegemann, D., "Determination of Thermocouple Transfer-Functions and Fluid-Flow Velocities By Temperature-Noise Measurements In Liquid Sodium," Progress - Nuclear Energy, Vol. 1, pp. 553 to 563, Pergamon Press, 1977.
28. Greene, D. A., Ahlgren, F. F., Meneely, D., "Acoustic Leak Detection/Location System for Sodium Heated Steam Generators," Second International Conf. on Liquid Metal Technology in Energy Production, Richland, Washington, April 1980.
29. "Pool-Type LMFBR Plant, 1000 MWe," EPRI NP-646, April 1978.