



INVESTIGATIONS ON FLOW REVERSAL IN STRATIFIED HORIZONTAL FLOW

Thomas Stäbler, Leonhard Meyer, Thomas Schulenberg
Forschungszentrum Karlsruhe, Institut für Kern- und Energietechnik,
Postfach 3640, 76021 Karlsruhe, Germany
thomas.staebler@iket.fzk.de

Eckart Laurien
Universität Stuttgart, Institut für Kernenergetik und Energiesysteme,
Pfaffenwaldring 31,
70569 Stuttgart, Germany

ABSTRACT

The phenomena of flow reversal in stratified flows are investigated in a horizontal channel with application to the Emergency Core Cooling System (ECCS) in Pressurized Water Reactors (PWR). In case of a Loss-of-Coolant-Accident (LOCA), coolant can be injected through a secondary pipe within the feeding line of the primary circuit, the so called hot leg, counter-currently to the steam flow. It is essential that the coolant reaches the reactor core to prevent overheating. Due to high temperatures in such accident scenarios, steam is generated in the core, which escapes from the reactor vessel through the hot leg. In case of sufficiently high steam flow rates, only a reduced amount of coolant or even no coolant will be delivered to the reactor core. The WENKA test facility at the *Institute for Nuclear and Energy Technologies (IKET)* at *Forschungszentrum Karlsruhe* is capable to investigate the fluid dynamics of two-phase flows in such scenarios. Water and air flow counter-currently in a horizontal channel made of clear acrylic glass to allow full optical access. Flow rates of water and air can be varied independently within a wide range. Once flow reversal sets in, a strong hysteresis effect must be taken into account. This was quantified during the present investigations. Local experimental data are needed to expand appropriate models on flow reversal in horizontal two-phase flow and to include them into numerical codes. Investigations are carried out by means of Particle Image Velocimetry (PIV) to obtain local flow velocities without disturbing the flow. Due to the wavy character of the flow, strong reflections at the interfacial area must be taken into account. Using fluorescent particles and an optical filter allows eliminating the reflections and recording only the signals of the particles. The challenges in conducting local investigations in stratified wavy flows by applying optical measurement techniques are discussed. Results are presented and discussed allowing a better fundamental understanding of the phenomena of flow reversal.

1 INTRODUCTION

In case of a postulated Loss-of-Coolant-Accident (LOCA) in Pressurized Water Reactors (PWR) it is essential that the coolability of the reactor core can be assured to avoid a core melt accident. LOCAs involve pipe ruptures in the primary and secondary circuits which can lead to a significant loss of coolant. Such a scenario is shown in figure 1. During such a scenario, coolant is injected by the Emergency Core Cooling System (ECCS) to avoid core uncovering or to reflood the core if already uncovered. In different ECC systems of German and American/Japanese PWRs different injection modes are used, such as cold leg injection, downcomer, upper plenum or combined hot and cold leg injection. During hot leg injection, the coolant is injected through a secondary pipe at the bottom of the feeding line of the primary circuit, the so called hot leg. It is indispensable that the coolant reaches the reactor core. In a typical reactor the coolant has to overcome 1.5 meters inside the hot leg before it reaches the reactor pressure vessel (RPV). This design was chosen to prevent high temperature gradients between the point of coolant injection and the hot walls of the RPV. Due to depressurization and high temperatures, steam will be generated in the core. The steam escapes from the reactor core vessel through the hot leg counter-currently to the injected coolant. In case of sufficiently high steam flow rates, only a reduced amount of coolant or even no coolant will be delivered to the reactor core independent of the coolant injection rate. This phenomenon is referred to as flow reversal and is also known as counter-current flow limitation (CCFL). During the Three Mile Island Accident in 1979 [3], CCFL prevented cooling water to flow from the pressurizer into the reactor cooling circuit causing the most severe nuclear accident in US-American history.

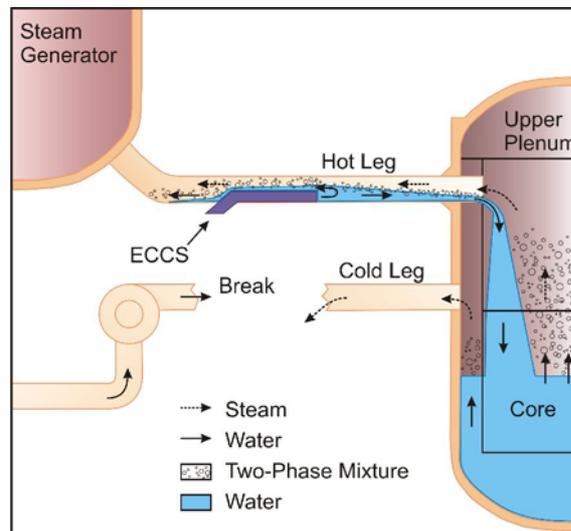


Figure 1: LOCA in PWR

Early work was done by Wallis in 1969 [1] and Richter et al. in 1978 [2]. Wallis investigated the stability of counter-current flows in horizontal ducts and the onset of flooding and presented a one-dimensional drift-flux model. Richter adjusted the Wallis correlation constant based on experimental investigations concerning the reflux phase in a scaled down PWR hot leg. Most works concerning CCFL –both experimental and theoretical– concentrated on reflux condensation cooling (Siddiqui and Banerjee [4], Ohnuki et al. [5], Lopez de Bertodano [6], Wang and Mayinger [7], Wongwises [8, 9] and Navarro [10]). Daly and Harlow [11] focused on CCFL during hot leg injection. They conducted a numerical study and derived a model for counter-current steam-water flows, but no experimental data supported their calculations. Full scale integral experimental investigations on different ECC

injection types were carried out in the Upper Plenum Test Facility (UPTF) within the 2D/3D Program [12]. The UPTF tests showed that the liquid in the hot leg was partially reversed for high steam flow rates during hot leg injection. Gargallo et al. [13] investigated the onset of flow reversal in horizontal counter-current stratified flows of water and air to understand and predict the behaviour of ECC during hot leg injection. The experiments yielded flow regime maps for different water inlet heights. A one-dimensional model to predict the occurrence of reversed flow was derived: only if the flow is subcritical and the Wallis correlation is fulfilled, reversed flow sets in. The transition to subcritical flow from an initially supercritical flow occurs suddenly in form of a hydraulic jump. An analytically developed model to predict the occurrence of a hydraulic jump was presented. Furthermore, a strong hysteresis effect was noted by Gargallo [14] and Ralph et al. [15] once flow reversal set in. To return to stable stratified flow, the air flow rate had to be reduced significantly compared to the air flow rate needed for the transition to reversed flow. Kolev et al. [16] pointed out that the analysis of ECCS flow phenomena with numerical codes is limited due to inappropriate correlations for inertia-dominated liquid flows caused by the lack of available experimental data.

In order to extend appropriate models on flow reversal in horizontal two-phase flows and to include them into numerical codes, local experimental data are needed. As there are still few experimental data available for flow reversal during hot leg injection in PWRs the WENKA test facility has been built at the *Institute for Nuclear and Energy Technologies (IKET)* at *Forschungszentrum Karlsruhe*. The test facility is capable to investigate the fluid dynamics of two-phase flows related to the LOCA-scenario with hot leg injection. The experiments by Gargallo et al. [13] and Gargallo [14] which were also conducted at the WENKA test facility are used as a basis for the present and ongoing investigations.

2 EXPERIMENTAL FACILITY

The WENKA test facility (figure 2) is used to conduct investigations in counter-current horizontal two phase flows. In the ongoing investigations water and air have been used as cold simulants for cooling water and steam. The simulants flow counter-currently in a horizontal channel with a geometry which represents a simplification of a PWR hot leg. Water is circulating in a closed loop and air in an open loop.

Water is pumped from a primary tank (capacity 600 litres) by a centrifugal pump. Before it enters the test section underneath a horizontal inlet plate, liquid flow rates are measured by two independent flow meters. The inlet plate can manually be adjusted to heights between 2 and 22 mm above the test-section floor. Under non-reversed conditions the water layer flows along the channel and returns to the primary tank through the water outlet, which is covered by an outlet plate.

The counter-current flow of air is fed into the test section by a blower, whereby it enters the experimental channel above the manually adjustable outlet plate. The air enters the area of interest in a well defined manner and accurate boundary conditions can therefore be assured. Under the condition of reversed flow, a portion of water is carried back over the inlet plate by the counter-current flow of air, resulting in a two-phase mixture. The two phases are separated by a cyclone upstream of the experimental channel. Finally, the air is released to the atmosphere. The separated water flows down into a secondary tank. For the present investigations, the test facility has been extended by a secondary water loop which connects the secondary tank to the primary tank. Any change of height in the secondary water tank is measured by a capacity level probe. A PID control circuit controls a pump, which conducts the exact amount of water reaching the secondary water tank coming from the cyclone. Subsequently, water flow rates are measured through a system of independent flow meters.

Backflow ratios can then be calculated by dividing the backflow rate by the flow rate of water injected into the test section. The accuracy of the backflow measurements using this system lies above 99%.

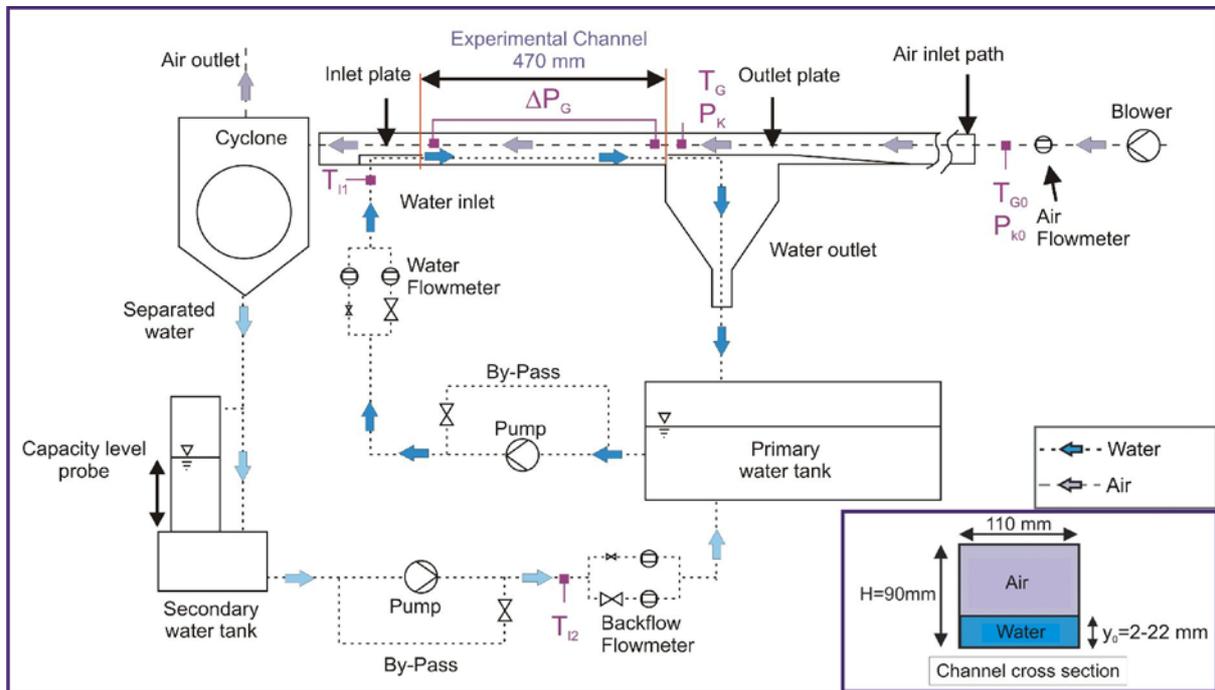


Figure 2: Schematic diagram of the WENKA test facility

Thermocouples (T) are used to measure the temperature variance in both phases. Pressure sensors (P) are used to measure the loss of pressure along the experimental channel, the static pressure of air within the air inlet path and the atmospheric pressure conditions. The data acquisition rate was set to 1 kHz.

The previously described liquid flow measurements consist of two magnetical-inductive flow meters in each water loop. Flow rates can be measured within a total range of 4 to 200 m³/h. For very low backflow ratios the temporal change in liquid height in the secondary tank can be considered to determine flow rates below 4 m³/h.

The area of interest of the test facility is the experimental channel, where air and water meet. The channel has a cross section of 90 x 110 mm² and a length of 470 mm. To allow full optical access, the experimental channel was made of clear acrylic glass.

3 EXPERIMENTAL RESULTS AND DISCUSSION

Gargallo [14] encountered a strong hysteresis effect once partial reversed flow set in. In order to quantify this phenomenon a series of experiments has been conducted. The existing flow regime maps by Gargallo et al. [13] and Gargallo [14] have been extended.

3.1 Flow regime map and hysteresis effect

Figure 3 shows the flow regime map for a water inlet height of $y_0 = 9$ mm, where the superficial gas velocity u_{GS} is plotted against the superficial liquid velocity u_{LS} . The outlet plate was set to the same height. The transition from stable counter-current stratified flow to partially reversed flow can be divided into two regions: The region in which the onset of partially reversed flow (OPRF) has a negative or zero slope and the region where it has a

positive slope. Beyond the onset of totally reversed flow (OTRF) the entire injected liquid will be carried over by the air. No liquid will reach the end of the experimental channel. Further details can be found in Gargallo et al. [13] and Gargallo [14]. For values of $u_{LS} > 0.115$ m/s the OPRF coincides with the OTRF, which means that a stratified flow will immediately change into a totally reversed flow due to the extremely high gas velocities.

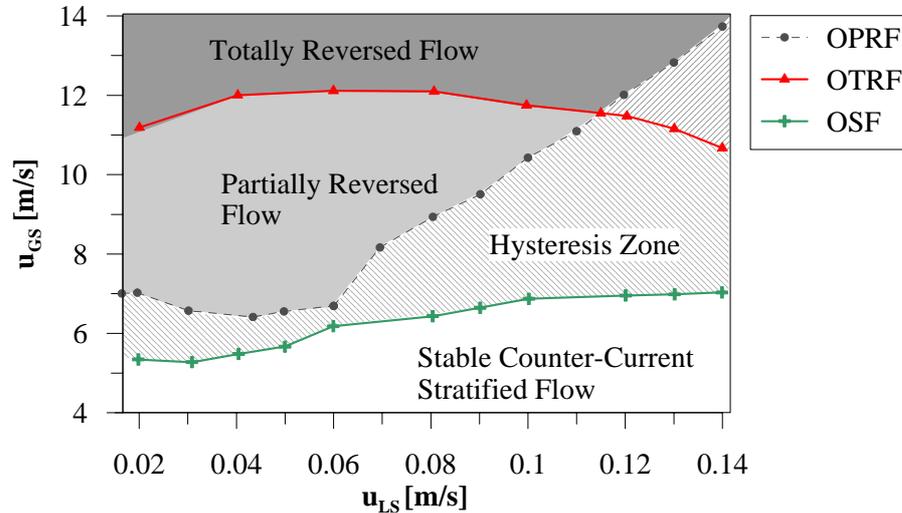


Figure 3: Flow regime map including hysteresis zone for $y_0 = 9$ mm

Once partially reversed flow sets in, the flow regime map to describe the transition to counter-current stratified flow is significantly different. A strong hysteresis describes the behaviour of the flow. The transition from partially reversed flow back to stable counter-current stratified flow occurs at much lower gas superficial velocities than the transition into the other direction. The flow regime maps were extended by the new curve of onset of stratified flow (OSF). For values of $u_{LS} > 0.115$ m/s, the transition to totally reversed flow will now occur at lower gas velocities than the transition from stable counter-current stratified flow to totally reversed flow. This is due to the fact that waves with high amplitudes in partially reversed flow increase the contact surface area of the liquid against the air flow and therefore results in a change of flow regime at lower gas velocities.

Figure 3 represents the conditions for the presented channel geometries. Some correlations to transfer the conditions to the reactor case can be found in Gargallo et al. [13]. The aim of related research is to describe the flow conditions by applying CFD-methods. Therefore, it is essential to provide local experimental data.

3.2 Measurement of local liquid flow velocities

To expand appropriate models on flow reversal in horizontal two-phase flow and to include them into numerical codes, local experimental data are needed. Laser-optical techniques allow measurements without disturbing the flow. With Particle Image Velocimetry (PIV) the two-dimensional flow field can be obtained by seeding the flow with particles, illuminating them with a light source and taking two pictures within a short time. The particle displacement and the knowledge of the time difference between the two illuminations deliver the velocities of the flow field.

Illumination of the liquid flow has been realised by a 50 mJ double-pulsed Nd:YAG laser. The laser light sheet entered the test section from the bottom to ensure uniform light intensity within the flow field. Due to the wavy character of stratified counter-current flows, however, the laser light will be reflected at the interfacial area. As waves propagate through

the channel constantly, the laser light will be reflected into several directions depending on the momentary shape of the interfacial area. In the worst case, the laser light could be reflected directly into the camera lens, causing the destruction of the camera's CCD chip. Furthermore, with conventional techniques, no local velocities could be obtained near the liquid surface due to the strong reflections being always present in the obtained pictures. Figure 4 shows two pictures of the same partially reversed flow at different times. As described above, the interface between the two phases changes constantly.

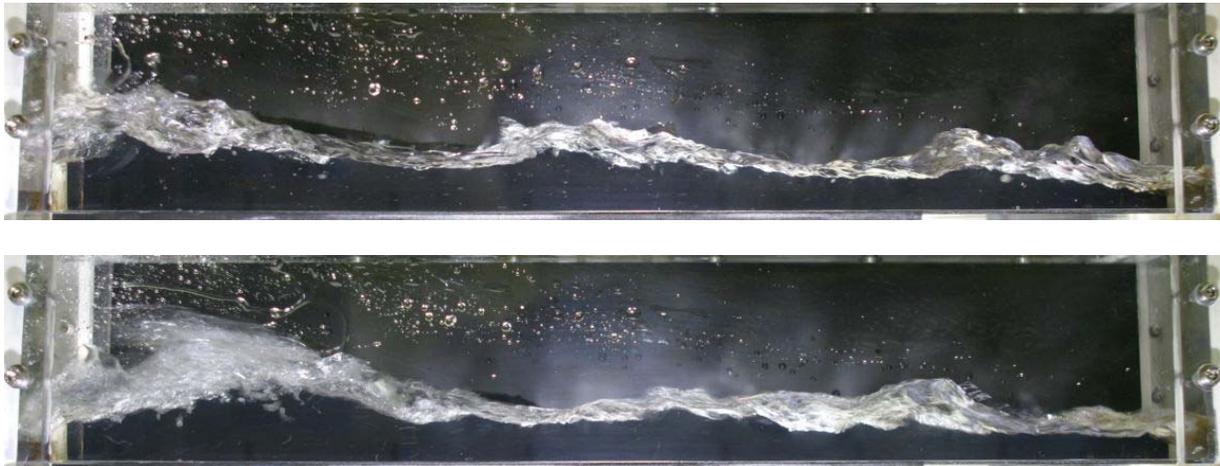


Figure 4: Pictures of partially reversed flow

Therefore, a more sophisticated PIV-setup has been chosen: by using fluorescent particles and an optical high-pass filter in front of the camera lens, all light of the wavelength of the laser and therefore all reflections at the liquid surface can be eliminated. The signal of the fluorescent particles will pass the optical filter as the fluorescent dye will be excited by the laser light and emit light at longer wavelengths than the laser light wavelength.

In the present investigations PMMA particles dyed with Rhodamine B with a diameter $20\mu\text{m} < d_p < 50\mu\text{m}$ have been chosen as seeding particles for the liquid phase. A dosing pump connected to the primary water loop is used to adjust the seeding density. A CCD-Camera (ImagerIntense, LaVision) has been used for picture acquisition. Figure 5 shows the vector plot of an instantaneous PIV-recording. As background, the raw image of the recording is shown. The reflections at the interfacial area are eliminated and velocities are only calculated in the regions where fluorescent particles can be seen.

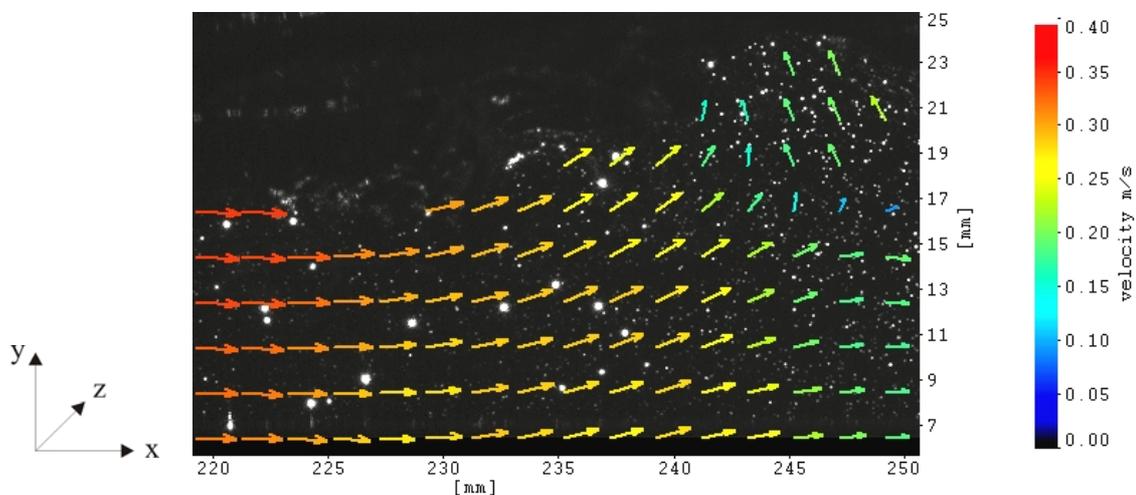


Figure 5: Vector plot of instantaneous PIV-recording

The aim is to obtain information on the time-averaged flow quantities of the entire process. Instantaneous information is not required for the present investigations. Therefore, a time-constant triggering mode has been chosen. Consequently, the interface will always change its location between the different recordings as waves propagate through the test section continuously. The flow can be subdivided into three different parts: the lower part of the test section with a constant layer of only liquid, the middle part where waves propagate and both liquid and air can be observed intermittently, and the upper part where no liquid can be found. Due to the wavy character of the flow, there will always be fewer particles with increasing channel height that can be used to measure the time-averaged flow field in the region with intermittency. To ensure accurate velocity calculations it is necessary, however, to record sufficient particles at any point within the flow field. Therefore, the obtained velocity vector plots were each averaged over 1500 instantaneous images.

As the air in the upper part is not seeded with particles no velocity vectors are obtained during the PIV calculations. The same is true in the middle part, where velocity vectors can only be calculated if liquid is present in the instantaneous recordings. To take account of this, the areas within the different images where no velocity vectors are obtained are omitted by software methods and therefore not included into subsequent averaging procedures. Regarding only the instantaneous images would lead to several different appearances of the flow field due to the constantly changing interfacial area. Averaging all instantaneous velocity plots yields a flow field where the entire middle part is filled up with velocity vectors, whereas the mean velocities are calculated as

$$\bar{u} = \frac{1}{\Delta t_{ges}} \int_t^{t+\Delta t_{ges}} u(\vartheta) d\vartheta \approx \frac{1}{N} \sum_{i=0}^N u_i. \quad (1)$$

By using this procedure, the time-averaged movement of all waves through the entire field of interest can be captured.

3.3 Results

Figure 6 shows the velocity profiles for the same partially reversed flow recorded with different PIV recordings. The wall normal coordinate y is plotted against the horizontal velocity component v_x in the main flow direction.

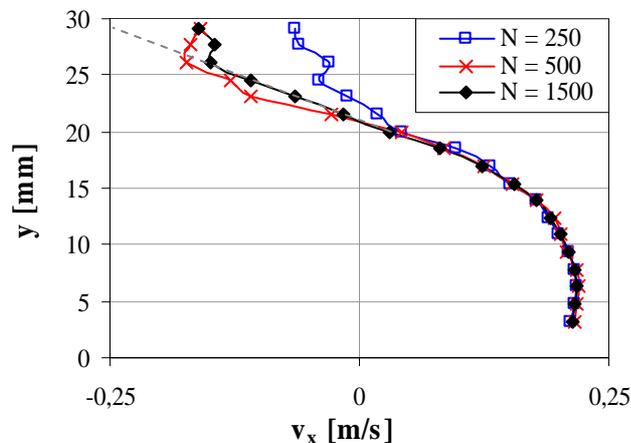


Figure 6: Dependence of velocity profiles on the number of PIV recordings

With increasing wall distance a bend is noted in all profiles. It can be seen that with an increasing number of PIV-recordings N , the bend in the curves occurs nearer to the maximum liquid height. The trend shows that for increasing N the curves converge to the dotted line, which can be assumed to indicate the real velocity profile for liquid heights near to the maximum liquid height. To obtain curves converging further to the dotted line would require a significantly larger number of PIV-recordings. For the present measurements a total of 1500 PIV-recordings per point were considered as sufficient.

Figure 7 shows liquid velocity profiles for partially reversed flows with different inlet conditions of the superficial velocities u_{LS} and u_{GS} for a water inlet height of $y_0 = 9$ mm. The measurements were conducted in the middle plane of the channel at a position $x = 235$ mm downstream the liquid inlet.

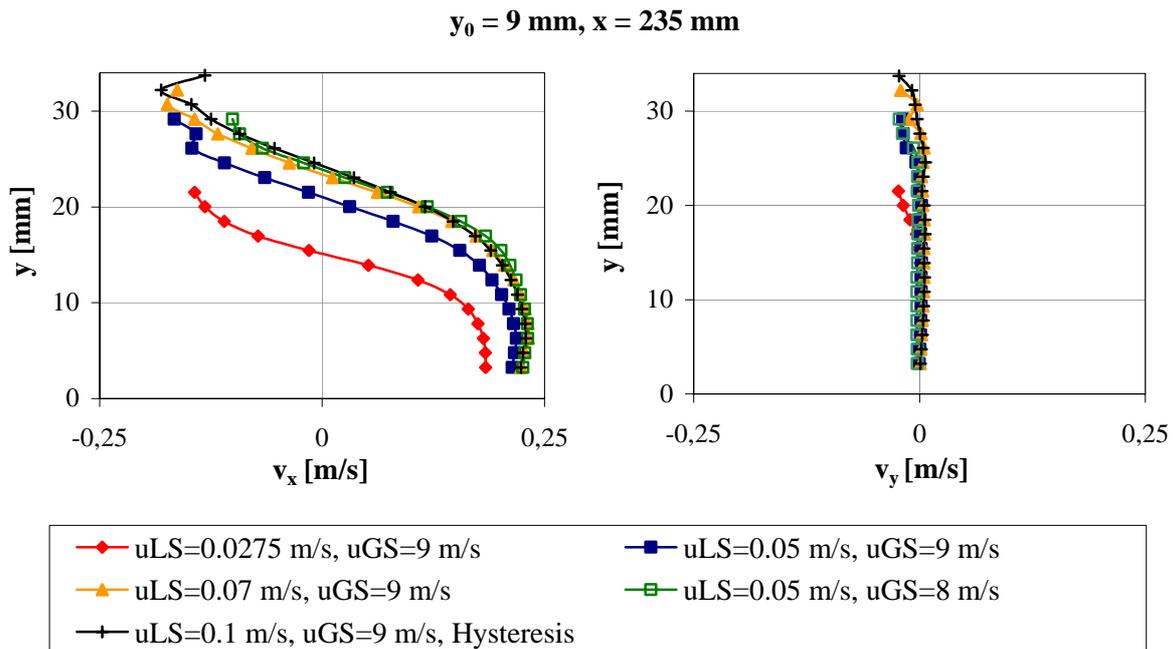


Figure 7: Liquid velocity profiles for partially reversed flows

With increasing liquid inlet velocities u_{LS} , the local velocity v_x in horizontal direction increases. Additionally, the maximum liquid height increases. A decrease in the gas inlet velocity u_{GS} yields higher local liquid velocities in the main flow direction. It must be noted that for high liquid superficial velocities u_{LS} , a limitation in the maximum values of the local velocities v_x exists. This behaviour is in good accordance with the observation of the hysteresis effect, where a further increase of the liquid inlet flow rate does not affect a higher liquid delivery rate. Furthermore, it has been found that the velocity component v_y in vertical direction shows only low values compared to v_x .

4 CONCLUSIONS

As there are still few experimental data available for the phenomena of flow reversal during hot leg injection a series of experiments has been conducted at the WENKA test facility. The results of the ongoing investigations allow a better fundamental understanding of the phenomena of flow reversal in horizontal two-phase flows.

Once flow reversal sets in, a strong hysteresis effect must be taken into account. The flow regime maps change significantly. The transition from partially reversed flow back to stable counter-current stratified flow occurs at much lower air superficial velocities than vice versa. It has been possible to extend available flow regime maps with the curve describing the

onset of stratified flow. The hysteresis zone has been quantified within the flow regime map for $y_0 = 9$ mm.

The aim of the current investigations is to obtain local experimental data. These data are needed to expand appropriate two-phase models in order to describe the flow conditions for horizontal counter-current flows with CFD-methods.

The challenges of conducting measurements of local velocities in two-phase flows with a variable interfacial area have been discussed. Fluorescent particles have to be used in order to eliminate the strong reflections at the interfacial area. A large number of PIV-recordings is necessary to obtain the time-averaged velocities in two-phase flows with variable interfacial areas. When increasing the number of recordings, the velocity profiles converge to a line which can be used to estimate the local velocities for the maximum liquid height. A direct measurement would require an enormous number of recordings and is not recommended due to very long data acquisition times and costs for the necessary fluorescent particles.

The local velocities in the main flow direction show a strong dependency on both, the water and the air inlet conditions. Velocities perpendicular to the main flow direction are very low compared with the velocities in the main flow direction.

ACKNOWLEDGMENTS

The authors would like to thank the IKET team for their help in building and instrumentating the test facility. Furthermore, special thanks is due Michael Andersen from Odense University and Marc Buckley from Université de Rennes 1 for their contribution regarding the presented measurements.

REFERENCES

- [1] G.B. Wallis, *One-Dimensional Two-Phase Flow*, McGraw-Hill, New York, 1969.
- [2] H. J. Richter, G. B. Wallis, K. H. Carter and S. L. Murphy, Deentrainment and Countercurrent Air-water Flow in a Model PWR Hot Leg, NRC-0193-9, U. S. Nuclear Regulatory Commission, Washington D. C., 1978.
- [3] Report of the President's Commission on the Accident at Three Mile Island. The need for change: the legacy of TMI. Kemeny-Report, Reprint, Pergamon Press, New York, 1979.
- [4] H. Siddiqui, S. Banerjee and K. H. Ardron, Flooding in an Elbow between a Vertical and a Horizontal or Near-horizontal Pipe. Part I: Experiments, *Int. J. Multiphase Flow*, vol. 12, No. 4, 1986, pp. 531-541
- [5] A. Ohnuki, H. Adachi and Y. Murao, Scale Effects on Countercurrent Gas-Liquid Flow in a Horizontal Tube Connected to an Inclined Riser, *Nuclear Engineering and Design*, vol. 107, 1988, pp. 283-294.
- [6] M. L. Lopez de Bertodano, Countercurrent Gas-Liquid Flow in a Pressurized Water Reactor Hot Leg, *Nuclear Science and Engineering*, vol. 117, 1994, pp. 126-133.
- [7] M. J. Wang and F. Mayinger, Simulation and Analysis of Thermal-Hydraulic Phenomena in a PWR Hot Leg Related to SBLOCA, *Nuclear Engineering and Design*, vol. 155, 1995, pp. 643-652.

- [8] S. Wongwises, Two-Phase Countercurrent Flow in a Model of a Pressurized Water Reactor Hot Leg, *Nuclear Engineering and Design*, vol. 166, 1996, pp. 121-133.
- [9] S. Wongwises, Flooding in a Horizontal Pipe with Bend, *Int. J. Multiphase Flow*, vol. 22, No. 1, 1996, pp. 195-201.
- [10] M. A. Navarro, Study of Countercurrent Flow Limitation in a Horizontal Pipe Connected to an Inclined One, *Nuclear Engineering and Design*, vol. 235, 2005, pp. 1139-1148.
- [11] B. J. Daly and F. H. Harlow, A Model of Counter-current Steam-Water Flow in Large Horizontal Pipes, *Nuclear Science and Engineering*, vol. 77, 1981, pp. 273-284.
- [12] P.S. Damerell, J.W. Simmons, Reactor Safety Issues Resolved by the 2D/3D Program, Prepared jointly by Japan Atomic Energy Research Institute, Gesellschaft für Anlagen- und Reaktorsicherheit (GRS) mbH, Siemens AG, UB KWU, U.S. Nuclear Regulatory Commission, Los Alamos National Laboratory, MPR Associates, Inc., 1993.
- [13] M. Gargallo, L. Meyer, T. Schulenberg, E. Laurien, Countercurrent Flow Limitations in Horizontal Stratified Flows of Air and Water, *Nuclear Engineering and Design*, vol. 235, 2005, pp. 785-804.
- [14] M. Gargallo, Counter-current Flow Limitations in Horizontal Stratified Flows of Air and Water, PhD Thesis, University of Stuttgart, Germany, 2004.
- [15] J. C. Ralph, G. Costigan and G. C. Gardner, Low and High Head Flooding for Countercurrent Flow in Short Horizontal Tubes, *Int. J. Multiphase Flow*, vol. 13, No. 1, 1987, pp. 47-55.
- [16] N. I. Kolev, H. Seitz and I. Roloff-Bock, Hot-Leg Injection: 3D versus 1D Three Velocity Fields Modeling and Comparison with UPTF Experiment, *Proc. of the ExHFT-5, 5th World Conference on Experimental Heat Transfer, Fluid Mechanics and Thermodynamics*, Thessaloniki, Greece, 2001.